



ScienceDirect®

Energy

Supports open access

15.3

CiteScore

9.0

Impact Factor

[Submit your article](#) ↗

[Guide for authors](#)

Menu

[Search in this journal](#)

About the journal

Energy is an international, multi-disciplinary journal in **energy engineering** and research, and a flagship journal in the Energy area. The journal aims to be a leading peer-reviewed platform and an authoritative source of information for analyses, reviews and evaluations related to **energy**.

The ...

[View full aims & scope](#)

Article publishing options

Open Access

Article Publishing Charge (APC): **USD 4,260 (excluding taxes)**. The amount you pay may be reduced during submission if applicable.

Review [this journal's open access policy](#).

Subscription

No publication fee charged to authors, and published articles are immediately available to subscribers.

32 days ⓘ

Time to first decision

126 days ⓘ

Review time

149 days ⓘ

Submission to acceptance

8 days ⓘ

Acceptance to publication



[View all insights](#)



Energy

Supports open access

15.3
CiteScore

9.0
Impact Factor

[Submit your article ↗](#)


[Guide for authors](#)

Menu

[Search in this journal](#)

Editorial board

Gender diversity of editors and editorial board members



- 69% man
- 29% woman
- 2% prefer not to disclose
- 0% non-binary or gender diverse

Data represents responses from 76.90% of 121 editors and editorial board members

Editorial board by country/region

119 editors and editorial board members in 39 countries/regions

- 1 China (22)
- 2 United States (11)
- 3 Brazil (8)

[See more editors by country/region](#)

Editor-in-Chief



Prof. Dr. Ruzhu Wang, PhD

Shanghai Jiao Tong University, Shanghai, China

Energy utilization in HVAC &, Refrigeration systems, Thermal activated cooling, Building energy saving with efficient use of solar and ambient energy, Innovative researches on Energy-Material-Air-Water,

[View full biography](#)

Deputy Editors-in-Chief



Neven Duić, PhD

University of Zagreb Faculty of Mechanical Engineering and Naval Architecture, Zagreb, Croatia

Energy planning, Demand response, Power to heat, Power to mobility, Energy system analysis

[View full biography](#)



Paula Ferreira, PhD

Guimarães, Portugal

Energy planning, Energy economics, Impact assessment, Sustainability

[View full biography](#)

Editor of Conference Relation and Special Issues



Henrik Lund, M.Sc.Eng., Ph.D., Dr.Techn

Aalborg University, Aalborg, Denmark

Energy Planning, Energy Systems Analysis, Energy Modelling, Green Transition, Energy Policy

[View full biography](#)

Subject Editors



Rafaela Agathokleous

University of Cyprus, Lefkosia, Cyprus



Ofelia Q. F. Araujo, PhD

Federal University of Rio de Janeiro, RIO DE JANEIRO, Brazil

CO₂ capture and utilization, Energy transition, Sustainability metrics, Fossil fuels, Lifecycle analysis, Energy efficiency, Decarbonization, Energy and environment, Process Systems Engineering

[View full biography](#)



Rangan Banerjee

Indian Institute of Technology Delhi, New Delhi, India

Demand Side Management, Energy Modelling, Power Systems Planning, Energy Planning and Policy, Cogeneration, Fuel cell/Hydrogen storage

[View full biography](#)



Wojciech Bujalski

Warsaw University of Technology, Warszawa, Poland



Huang Diangui, PhD

University of Shanghai for Science and Technology School of Energy and Power Engineering, Shanghai, China

Wind Energy, turbomachinery

[View full biography](#)



Neven Duić, PhD

University of Zagreb Faculty of Mechanical Engineering and Naval Architecture, Zagreb, Croatia

Energy planning, Demand response, Power to heat, Power to mobility, Energy system analysis

[View full biography](#)



Yee Van Fan, PhD

Brno University of Technology, Brno, Czech Republic

Solid waste treatment and management, Composting, Waste to energy, Emissions assessment and mitigation, Transportation Mode Choice, Life Cycle Assessment, Footprint and sustainability assessment, Biomass, Renewable Energy Integration, Electrification, Biochar

[> View full biography](#)



Yilin Fan, PhD

Thermal Laboratory and Energy of Nantes, Nantes, France

Heat and mass transfer, Thermal energy recovery, storage and management, Optimization of energy systems, Heat sinks and heat exchangers, Nature-inspired design and topology optimization

[> View full biography](#)



Paula Ferreira, PhD

Guimarães, Portugal

Energy planning, Energy economics, Impact assessment, Sustainability

[> View full biography](#)



Tianshu S. Ge

Shanghai Jiao Tong University - Fahu Campus, Shanghai, China



Yurong He, PhD

Harbin Institute of Technology, Harbin, China

Renewable energy, Energy storage, Energy management, Flow &, heat and mass transfer, Batteries, Phase change material, Fluidization in chemical engineering

[> View full biography](#)



Gregorio Iglesias, PhD

University College Cork, Ireland AND University of Plymouth, Cork, Ireland

Offshore renewable energy, marine renewable energy, wind energy, wave energy, tidal energy, coastal engineering, offshore wind



Chew Tin Lee, PhD

University of Technology Malaysia, Skudai, Malaysia

Biomass to energy, Energy and environment, Greenhouse gases inventory, Sustainable materials, Waste management, Circular Economy, Greenhouse gases inventory

[View full biography](#)



Qiang Liao, PhD

Chongqing University School of Energy and Power Engineering, Chongqing, China

Heat and Mass Transfer, Interfacial Phenomena, Fuel Cell, Energy Conservation, Microbial Energy Conversion

[View full biography](#)



Henrik Lund, M.Sc.Eng., Ph.D., Dr.Techn

Aalborg University, Aalborg, Denmark

Energy Planning, Energy Systems Analysis, Energy Modelling, Green Transition, Energy Policy

[View full biography](#)



Lingai Luo

National Centre for Scientific Research, Paris, France

[View full biography](#)

Diego Fernando Manotas-Duque, PhD

University of the Valley, Cali, Colombia

Energy economics, energy finance, financial engineering and energy planning, incorporating economic and environmental criteria.

[View full biography](#)



Natasa Markovska, PhD

Macedonian Academy of Sciences and Arts, Skopje, North Macedonia


Sustainable Energy Development, Decarbonization

[View full biography](#)



Adel Mellit

University of Mohammed Seddik Benyahia Jijel Faculty of Science and Technology, Jijel, Algeria



Benedetto Nastasi, PhD

University of Rome Tor Vergata, Roma, Rome, Italy

Hydrogen, Smart Energy Systems, Energy Flexibility, Energy in Buildings, Renewables, Building energy data and analytics

[View full biography](#)



Sandro Nižetić, PhD, Professor

University of Split Faculty of Electrical Engineering Mechanical Engineering and Naval Architecture, Split, Croatia

Clean Energy and Sustainable Engineering, Energy Efficiency, Mechanical Engineering, Thermodynamics and Fluid Mechanics, Energy and Exergy Analysis, Renewable Energy, Heating and Cooling, Energy Economics, Energy Savings, Energy use and integration

[View full biography](#)



Xunmin Ou

Tsinghua University, Beijing, China

Transport Energy, LCA, Energy Strategy

[View full biography](#)



Tomislav Pukšec, PhD

University of Zagreb Faculty of Mechanical Engineering and Naval Architecture, Zagreb, Croatia

smart energy systems, district heating, GIS, biogas, energy demand modelling, sustainable development, renewables

[View full biography](#)



Iva Skov, PhD

Aalborg University Copenhagen Department of Planning, København, Denmark

Energy Planning and Renewable Energy Systems, Power-to-X, electrofuel

[View full biography](#)



Isabel Soares

University of Porto, Porto, Portugal

[View full biography](#)



Vladimir Stevanovic, PhD

University of Belgrade, Beograd, Serbia

Thermal and Nuclear Power Engineering, Thermal-Hydraulics, Heat and Mass Transfer, Energy Planning and Policy

[View full biography](#)



Petar S. Varbanov, Dr Habil, PhD

Brno University of Technology, Brno, Czech Republic

Energy saving and efficiency, Development and implementation of Process Integration, Total Site and regional integration for energy, Water and Circular Economy– including retrofit, Waste to energy, Wastewater minimisation leading to GHG and water footprints reduction

[View full biography](#)



Ruzhu Wang, PhD

Shanghai Jiao Tong University, Shanghai, China

Energy utilization in HVAC &, Refrigeration systems, Thermal activated cooling, Building energy saving with efficient use of solar and ambient energy, Innovative researches on Energy-Material-Air-Water,

[View full biography](#)

Shengwei Wang

The Hong Kong Polytechnic University Department of Building Environment and Energy Engineering, Hong kong, Hong Kong



Chun Yang, PhD

Nanyang Technological University, Singapore, Singapore

Thermal Engineering, Microfluidics, Electrokinetic Transport Phenomena, Thermal Energy

[View full biography](#)



Chuan Zhang, PhD

Peking University, Beijing, China

Energy systems decarbonization, techno-economic analysis, environment impact assessment, thermodynamics

[View full biography](#)



Xiliang Zhang, PhD

Tsinghua University, Beijing, China



Xudong Zhao, PhD

University of Hull, Hull, United Kingdom

Energy Efficiency, Renewable Energy, Solar Thermal and PV, Sustainable Heating and Cooling, Heat Pump, Air Dehumidification, Smart Energy Systems

[View full biography](#)



Davide Ziviani, PhD

Purdue University, West Lafayette, Indiana, United States

Heat Pumps, Thermal Management Systems, Deep Space Habitats, HVAC&R

[View full biography](#)

Honorary Editor



Soteris Kalogirou, PhD, DSc

Cyprus University of Technology, Lemesos, Cyprus

Solar Energy, Renewable Energy Systems, Solar Cooling, Desalination

[View full biography](#)

Ethics Editor

Meng Yuan

Aalborg University, Aalborg, Denmark

Editorial Board Members

Robert Boehm

University of Nevada Las Vegas, Las Vegas, Nevada, United States



Maria de Graca Carvalho

University of Lisbon, Lisboa, Portugal



M Dolores Esteban

Universidad Politécnica de Madrid, Boadilla del Monte, Madrid, Spain



Mejdi Jeguirim

Mulhouse Materials Science Institute, Mulhouse, France

[View full biography](#)

Alberto Mirandola

University of Padua, Padova, Italy



R. Venkata Rao

Sardar Vallabhbhai National Institute of Technology, Surat, India

[View full biography](#)



Ray (Zhenhua) Rui

China University of Petroleum Beijing, Chang Ping Qu, China

[View full biography](#)

Enrico Sciubba

University of Rome La Sapienza, Roma, Italy

John Twidell

AMSET Centre, Market Harborough, United Kingdom



Peng Zhang

Shanghai Jiao Tong University - MinHang Campus, Shanghai, China

[View full biography](#)



Mustafa Acaroğlu

Selçuk University, Konya, Türkiye

Energy Engineering, Fuel, Biofuel, Renewable Energy sources, Energy policy

[View full biography](#)



Yuri Aristov

Boreskov Institute of Catalysis SB RAS, Novosibirsk, Russian Federation

Physical Chemistry, Adsorptive heat storage and conversion, Thermochemical heat storage

[View full biography](#)



Bin Chen

Beijing Normal University, Beijing, China

Environmental Science, Energy Sustainability, Energy NEXUS, Environmental management, Climate change, Urban sustainability

[View full biography](#)



José Goldemberg

University of São Paulo, São Paulo, Brazil

[View full biography](#)



Xiaosong Hu

Chongqing University, Chongqing, China

New energy vehicle power system control and optimization



Hongguang Jin

Chinese Academy of Sciences, Beijing, China

[View full biography](#)



Hussam Jouhara

Brunel University London, London, United Kingdom

Heat pipes, Heat Energy Storage, Cryogenic heat transfer systems, Single and two-phase heat transfer, Waste heat recovery systems, Heat pipe based solar collectors, Development of sizing tools of heat exchangers, Energy active shelves, Thermal management

[View full biography](#)



Tahir Hikmet Karakoç

Eskişehir Technical University, Eskişehir, Türkiye

Willett Kempton

University of Delaware, Newark, Delaware, United States

[View full biography](#)



Venkat Krishnan

National Renewable Energy Laboratory, Golden, Colorado, United States



Omid Mahian

Ningbo University Faculty of Mechanical Engineering and Mechanics, Ningbo, China

Renewable Energy systems, Hybrid energy system, Nanotechnology, Hybrid computational methods

[View full biography](#)



Christos Markides

Imperial College London, London, United Kingdom

Energy, Heat Transfer, Thermal Engineering, Multiphase Flows, Optical Diagnostics, Experimental Techniques

[View full biography](#)



Alan Meier

E O Lawrence Berkeley National Laboratory, Berkeley, California, United States

[View full biography](#)



Tatiana Morosuk

TU Berlin University, Berlin, Germany

Exergy-based methods, Advanced exergy-based methods, Refrigeration, Cryogenics, Power generation, Optimization

[View full biography](#)



Constantine Rakopoulos

National Technical University of Athens, Zografos, Greece

Internal combustion engines, Combustion and Pollution, Heat transfer

[View full biography](#)



Dimitrios Rakopoulos

Centre for Research and Technology-Hellas, Thessaloniki, Greece

[> View full biography](#)



Julieta Schallenberg

University of Las Palmas de Gran Canaria, Las Palmas de Gran Canaria, Spain


renewable energies, 100% RES, wind, solar, RES application, desalination, etc., RES storage

[> View full biography](#)



Claudia Sheinbaum-Pardo

Autonomous National University of Mexico Faculty of Engineering, Ciudad de México, Mexico



Gordana Stefanovic

University of Niš, Niš, Serbia



Sergio Ulgiati

University of Naples Parthenope, Napoli, Italy

[> View full biography](#)



Vittorio Verda

Polytechnic of Turin, Torino, Italy



William M. Worek

Texas A&M University-Kingsville Eagle Ford Center for Research and Outreach, Kingsville, Texas, United States

[> View full biography](#)



Ernst Worrell

Utrecht University, Utrecht, Netherlands

Sustainable energy systems, energy efficiency, industrial energy use, material efficiency, circular economy

[View full biography](#)



J. Xaman †

National Center for Research and Technological Development Department of Mechanical Engineering, Cuernavaca, Morelos, Mexico



Na Zhang

Chinese Academy of Sciences, Beijing, China

[View full biography](#)



Fengqi Zhou

Shanghai Academy of Social Sciences, Shanghai, China

Term ending 2025



Mohammad Ahmad Al-Nimr

Jordan University of Science and Technology Department of Mechanical Engineering, Irbid, Jordan

[View full biography](#)



Beng Wah Ang

National University of Singapore, Singapore, Singapore

[View full biography](#)



Kathleen Bernardo Aviso

De La Salle University, Manila, Philippines

[View full biography](#)



Giorgio Besagni

Polytechnic of Milan Department of Energy, Milano, Italy

[View full biography](#)



Monica Carvalho

Paraiba Federal University, JOAO PESSOA, Brazil

[View full biography](#)

Silvio De Oliveira, Jr

University of São Paulo, São Paulo, Brazil

[View full biography](#)



Daniel Favrat

Federal Polytechnic School of Lausanne, Lausanne, Switzerland

[View full biography](#)



Aleksandar Georgiev

University of Telecommunications and Posts, Sofia, Bulgaria

[View full biography](#)



Simon Harvey

Chalmers University of Technology, Göteborg, Sweden

[> View full biography](#)



Sotirios Karellas

National Technical University Of Athens Laboratory of Steam Boilers and Thermal Plants, Zografou, Greece

[> View full biography](#)



Zygmunt Kolenda

AGH University of Krakow, Krakow, Poland



Tyrone Lin

National Dong Hwa University, Shoufeng, Taiwan



Noam Lior

University of Pennsylvania, Philadelphia, Pennsylvania, United States

[> View full biography](#)



Lin Lu

The Hong Kong Polytechnic University Department of Building Environment and Energy Engineering, Hong kong, Hong Kong

[> View full biography](#)



Michael Moran

The Ohio State University, Columbus, Ohio, United States



Silvia Azucena Nebra

Federal University of the ABC, SANTO ANDRE, Brazil



Younes Noorollahi

University of Tehran, Tehran, Iran (Islamic Republic of)

[View full biography](#)



Paweł Ochoń

Cracow University of Technology Faculty of Environmental Engineering and Energy, Krakow, Poland

[View full biography](#)



Luis M. Serra

University of Zaragoza, Zaragoza, Spain

[View full biography](#)



Arnaldo Walter

State University of Campinas School of Mechanical Engineering, CAMPINAS, Brazil



Qiuwang Wang

Xi'an Jiaotong University School of Energy and Power Engineering, Xian, China

[View full biography](#)



Chi-Keung Woo

Kowloon Tong, Hong Kong

[View full biography](#)



Jinyue Yan

The Hong Kong Polytechnic University, Hong Kong, Hong Kong

[View full biography](#)



Ryohei Yokoyama

Osaka Metropolitan University, Osaka, Japan

[View full biography](#)



Peng Zhou

China University of Petroleum East China, Dongying, China

[View full biography](#)

Term ending 2026



Manimagalay Chetty

Cape Peninsula University of Technology - Bellville Campus, Bellville, South Africa

[View full biography](#)



Gianfranco Chicco

Polytechnic of Turin, Torino, Italy

[View full biography](#)



Abel Hernandez-Guerrero

University of Guanajuato, Guanajuato, Mexico

[View full biography](#)



Yunho Hwang

University of Maryland, College Park, Maryland, United States

[View full biography](#)



Mark Kaiser

Louisiana State University, Baton Rouge, Louisiana, United States



Şiir Kılıç

Scientific and Technological Research Council of Turkey, Ankara, Türkiye

[View full biography](#)



Jyoti Parikh

Integrated Research and Action for Development, New Delhi, India

[View full biography](#)



Roberto Schaeffer

Federal University of Rio de Janeiro Alberto Luiz Coimbra Institute for Graduate Studies and Research in Engineering, RIO DE JANEIRO, Brazil

[View full biography](#)



Ram Shrestha

Asian Institute of Technology Department of Energy Environment and Climate Change, Khlong Nueng, Thailand



Wojciech Stanek

Silesian University of Technology, Gliwice, Poland

[View full biography](#)



Pascal Stouffs

University of Pau and Pays de l'Adour, Pau, France



Jesse Van Griensven Thé

University of Waterloo, Waterloo, Ontario, Canada

[View full biography](#)



George Tsatsaronis

TU Berlin University, Berlin, Germany

[View full biography](#)



Zhien Zhang

The Ohio State University, Columbus, Ohio, United States

[View full biography](#)

Assistant Editors



Géremi Gilson Dranka

Federal Technological University of Paraná, Paraná, Brazil

[View full biography](#)



Weili Luo

Shanghai Jiao Tong University, Shanghai, China



Mette Reiche Sørensen

Aalborg University, Aalborg, Denmark



Jiayun Wang, PhD

University of Shanghai for Science and Technology, Shanghai, China

[View full biography](#)

Book Review Panel



Mohammad Ahmad Al-Nimr

[View full biography](#)

John Twidell



Krzysztof Ptasinski



Ernst Worrell, PhD

[View full biography](#)

All members of the Editorial Board have identified their affiliated institutions or organizations, along with the corresponding country or geographic region. Elsevier remains neutral with regard to any jurisdictional claims.



All content on this site: Copyright © 2025 Elsevier B.V., its licensors, and contributors. All rights are reserved, including those for text and data mining, AI training, and similar technologies. For all open access content, the relevant licensing terms apply.



Volume 227

15 July 2021

[< Previous vol/issue](#)

[Next vol/issue >](#)

Receive an update when the latest issues in this journal are published

 [Sign in to set up alerts](#)

● Full text access

Editorial Board

Article 120883



[View PDF](#)

Full Length Articles

Research article ● Full text access

Effect of oxidation temperature and oxygen concentration on macro characteristics of pre-oxidised coal spontaneous combustion process

Hui-Fei Lü, Jun Deng, Da-Jiang Li, Fan Xu, ... Chi-Min Shu

Article 120431



[View PDF](#)

[Article preview](#) 

Research article ● Full text access

Do governmental subsidies improve the financial performance of China's new energy power generation enterprises?

Guoliang Luo, Yingxuan Liu, Liping Zhang, Xuan Xu, Yiwei Guo



Thermal performance and economic evaluation of NaCl–CaCl₂ eutectic salt for high-temperature thermal energy storage

Heqing Tian, Weilong Wang, Jing Ding, Xiaolan Wei

Article 120412

[View PDF](#)[Article preview](#)

Research article ● Full text access

Investigation of the near wake of a horizontal-axis wind turbine model by dynamic mode decomposition

Chong Sun, Tian Tian, Xiaocheng Zhu, Ouyang Hua, Zhaohui Du

Article 120418

[View PDF](#)[Article preview](#)

Research article ● Open access

Scenarios for carbon capture integration in a waste-to-energy plant

Elisa Magnanelli, Jostein Mosby, Michael Becidan

Article 120407

[View PDF](#)[Article preview](#)

Research article ● Full text access

Experimental study on novel waste heat recovery system for sulfide-containing flue gas

Hongqiang Ma, Nuo Liang, Yemin Liu, Xinmei Luo, ... Gang Wang

Article 120479

[View PDF](#)[Article preview](#)

Research article ● Open access

Analysis of the integrated energy system in residential scale: Photovoltaics, micro-cogeneration and electrical energy storage

Janusz Kotowicz, Wojciech Uchman

Article 120469

[View PDF](#)[Article preview](#)

Research article ● Full text access

Reliability-cost trade-offs for electricity industry planning with high variable renewable energy penetrations in emerging economies: A case study of Indonesia's Java-Bali grid

Yusak Tanoto, Navid Haghdadi, Anna Bruce, Iain MacGill

Article 120474

[View PDF](#)[Article preview](#)

Research article ● Open access

SJR



SJR

Scimago Journal & Country Rank

Enter Journal Title, ISSN or Publisher Name

Home

Journal Rankings

Journal Value

Country Rankings

Viz Tools

Help

About Us

Energy

COUNTRY	SUBJECT AREA AND CATEGORY	PUBLISHER	SJR 2024
United Kingdom	Energy	Elsevier Ltd	2.211 Q1
Universities and research institutions in United Kingdom Media Ranking in United Kingdom	Energy Engineering and Power Technology Energy (miscellaneous) Fuel Technology Renewable Energy, Sustainability and the Environment Engineering Building and Construction Civil and Structural Engineering Electrical and Electronic Engineering Industrial and Manufacturing Engineering Mechanical Engineering Environmental Science Management, Monitoring, Policy and Law Pollution Mathematics Modeling and Simulation		H-INDEX
			274

PUBLICATION TYPE	ISSN	COVERAGE	INFORMATION
Journals	03605442, 18736785	1976-2025	Homepage How to publish in this journal Contact

SCOPE

Energy is an international, multi-disciplinary journal in energy engineering and research. The journal aims to be a leading peer-reviewed platform and an authoritative source of information for analyses, reviews and evaluations related to energy. The journal covers research in mechanical engineering and thermal sciences, with a strong focus on energy analysis, energy modelling and prediction, integrated energy systems, energy planning and energy management. The journal also welcomes papers on related topics such as energy conservation, energy efficiency, biomass and bioenergy, renewable energy, electricity supply and demand, energy storage, energy in buildings, and on economic and policy issues, provided such topics are within the context of the broader multi-disciplinary scope of Energy.

 Join the conversation about this journal

 [Quartiles](#)


FIND SIMILAR JOURNALS ?

1
Energy Conversion and
Management: X
GBR

68%
similarity

2
Energy Conversion and
Management
GBR

67%
similarity


3
International Journal of
Green Energy
USA

61%
similarity


4
Sustainable
Technologie
GBR

6
si


SJR

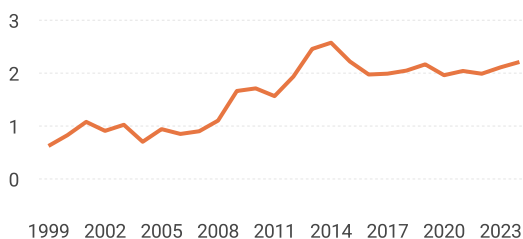


Total Documents

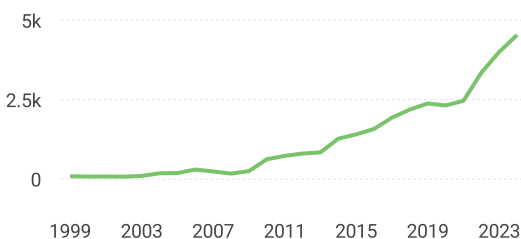


Total Cites Self-Cites

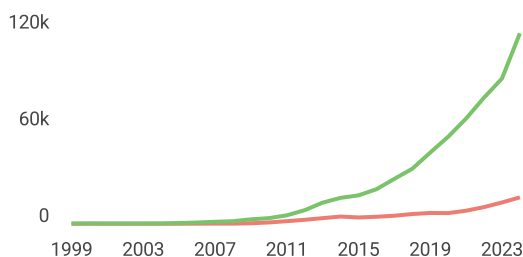


Citations per document

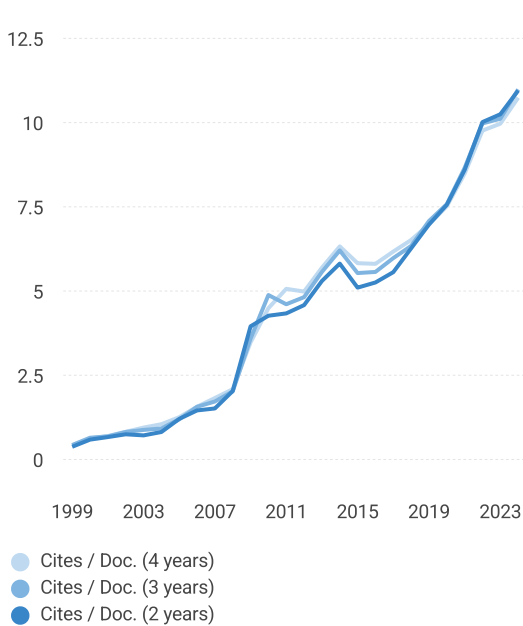


External Cites per Doc Cites per Doc

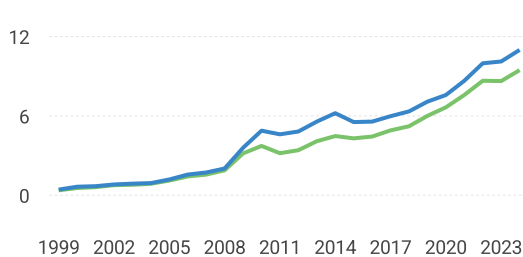

% International Collaboration

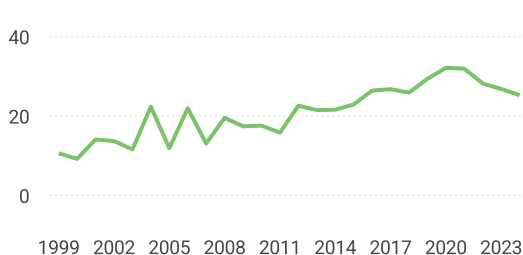

Citable documents Non-citable documents

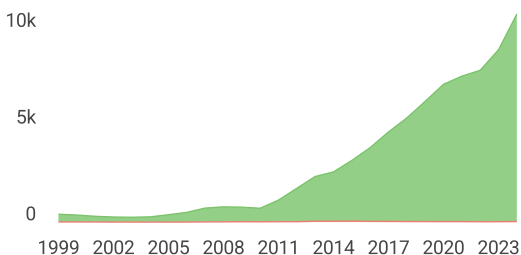


Cited documents Uncited documents



% Female Authors



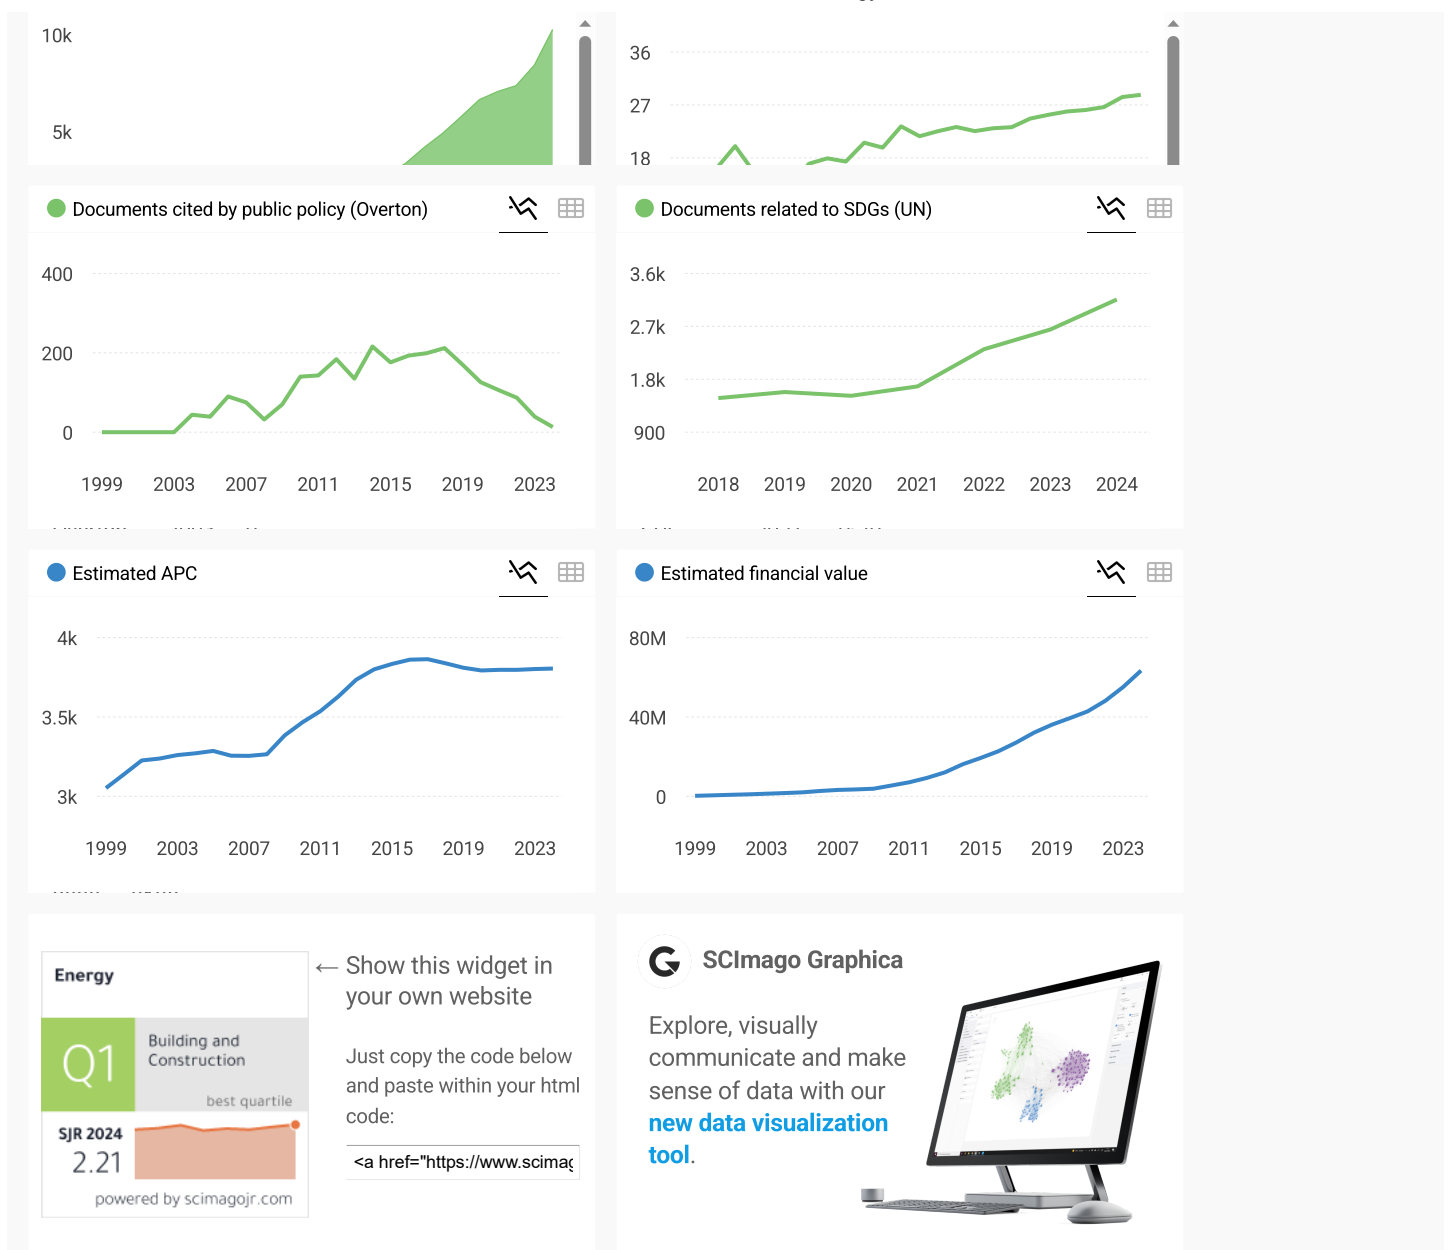

Metrics based on Scopus® data as of March 2025



Tareen 6 months ago

Energy journal: Waste of time and efforts ...

The submission process with *Energy* journal has been a disappointing and frustrating experience. Despite submitting a high-quality article that initially received minor revisions (with one of the two reviewers approving it outright), the journal's handling of the author addition was unprofessional.

Following their guidelines, we submitted a revision that included an author who was initially part of the manuscript team but omitted to expedite the review process. However, even though the journal allows the addition of authors at this stage, they unexpectedly rejected the submission. They neither provided a clear rationale nor engaged in any meaningful dialogue about their decision. This kind of approach, where genuine concerns and clarifications are dismissed without proper



Source details

Energy

Years currently covered by Scopus: from 1976 to 2025

Publisher: Elsevier

ISSN: 0360-5442 E-ISSN: 1873-6785

Subject area: Mathematics: Modeling and Simulation Engineering: Civil and Structural Engineering

Engineering: Building and Construction Engineering: Mechanical Engineering Energy: Fuel Technology

View all

Source type: Journal

View all documents >

Set document alert

Save to source list

CiteScore CiteScore rank & trend Scopus content coverage

CiteScore 2023

15.3 = $\frac{184.935 \text{ Citations } 2020 - 2023}{12.098 \text{ Documents } 2020 - 2023}$

Calculated on 05 May, 2024

CiteScoreTracker 2024

16.4 = $\frac{235.137 \text{ Citations to date}}{14.308 \text{ Documents to date}}$

Last updated on 05 April, 2025 • Updated monthly

CiteScore rank 2023


Category	Rank	Percentile
Mathematics		
Modeling and Simulation	#6/324	98th
Engineering		
Civil and Structural Engineering	#8/379	98th

View CiteScore methodology > CiteScore FAQ > Add CiteScore to your site

CiteScore 2023
15.3

SJR 2023
2.110

SNIP 2023
2.052



Reliability-cost trade-offs for electricity industry planning with high variable renewable energy penetrations in emerging economies: A case study of Indonesia's Java-Bali grid

Yusak Tanoto ^{a, c, *}, Navid Haghdadi ^b, Anna Bruce ^b, Iain MacGill ^a

^a School of Electrical Engineering and Telecommunications and Collaboration on Energy and Environmental Markets, University of New South Wales, High Street, Kensington, NSW, 2033, Sydney, Australia

^b School of Photovoltaic and Renewable Energy Engineering and Collaboration on Energy and Environmental Markets, University of New South Wales, High Street, Kensington, NSW, 2033, Sydney, Australia

^c Electrical Engineering Department, Petra Christian University, Surabaya, Indonesia

ARTICLE INFO

Article history:

Received 9 November 2020

Received in revised form

7 March 2021

Accepted 23 March 2021

Available online 31 March 2021

Keywords:

Reliability-cost trade-offs

Generation planning

Fixed unserved energy

Priced unserved energy

Emerging economies

ABSTRACT

Electricity industries in emerging economies face particular challenges in delivering affordable, environmentally sustainable, and secure power given growing demand and limited financial resources. While supply reliability is often poor and emission reductions given lower priority, solar and wind are now amongst our cheapest supply options but highly variable. Our study seeks to demonstrate the potential value of trading-off reliability standards against higher renewables and lower industry costs in future generation planning. We use an open-source, evolutionary programming-based, capacity expansion planning tool, NEMO, to solve least cost generation mixes for Indonesia's Java-Bali grid in 2030. We explicitly test the cost and emission impacts of reliability targets of 0.005%–5% unserved energy (USE), modelled as both a hard optimization constraint and a penalty price on USE in the cost function. Our results highlight that lower reliability targets can increase solar and wind penetrations, reducing CO₂ emissions while reducing industry costs. Both methods of incorporating reliability delivered similar outcomes but pricing USE had some advantages for optimization over hard constraint setting. While the impacts of lower reliability on consumers requires careful consideration, our study highlights the potential cost and emission implications of arguably unrealistic reliability targets in generation planning for emerging economies.

© 2021 Elsevier Ltd. All rights reserved.

1. Introduction

Electricity industries in many emerging economies¹ achieve only relatively low security and reliability of supply for reasons including rapid demand growth, yet financial constraints, that

result in insufficient generation and network capacity. Many of these countries also currently have a high reliance on fossil fuel generation and, certainly across much of Southeast Asia, especially coal [1]. The technical maturity, dispatchability and highly competitive costs of fossil fuel options has been a key factor in their dominant role. Their adverse environmental impacts have, understandably, been a second order concern.

Over the past decade, extraordinary technical progress, and cost reductions for several renewable energy (RE) technologies, notably wind and solar photovoltaics (PV), has seen them playing a growing role in many electricity industries, mostly in more developed jurisdictions, and supported by a range of renewable policy support mechanisms. Now, however, they are increasingly seen as cost-competitive in their own right [2]. Although countries like China and India are aiming to reduce fossil fuel in electricity generation, many emerging economies, including some in Southeast Asia,

* Corresponding author. School of Electrical Engineering and Telecommunications and Collaboration on Energy and Environmental Markets, University of New South Wales, High Street, Kensington, NSW, 2033, Sydney, Australia.

E-mail address: y.tanoto@student.unsw.edu.au (Y. Tanoto).

¹ We use the term emerging economies rather than developing countries to better acknowledge many countries' general socio-economic development progress, including income and energy access, and transition efforts towards more sustainable electricity industries. Certainly, Indonesia is likely better characterized as an emerging economy rather than a developing one. However, it still experiences far lower grid reliability than industrialized countries typically do, a characteristic shared by many other emerging as well as developing economies.

continue to prioritize coal fired power plants in their long-term planning processes, and as policymakers have failed to limit new coal plant capacity and reduce existing units [3].

Our study aims to address the question of how electricity planning for these jurisdictions might better capture the potential generation cost reductions as well as improved environmental outcomes offered by variable renewable energy (VRE), while managing their challenges for system security and reliability. Electricity industry planners have always faced a trade-off between their objectives of reducing total industry generation costs yet also delivering secure and reliable supply versus reliability outcomes. Wind and solar offer low cost but highly variable and somewhat unpredictable generation, adding to the complexity of this trade-off. More generally there is the question of what the right level of reliability to seek to deliver. Our study particularly focuses on the question of how emerging economies can be more thoughtful about how they set reliability targets when undertaking future electricity generation planning scenarios with high renewables, and what the implications of lower reliability targets are for costs and environmental outcomes.

A large and growing number of studies has explored long-term electricity generation planning with high VRE scenarios albeit mostly for the electricity industries of industrialized economies. In emerging economies, however, these studies generally seek to obtain the 'least cost' future generation technology mix, within security and reliability 'constraints' and perhaps environmental 'constraints' or policy mechanisms. Various optimization methods and tools have been used for the cases of emerging economies electricity industries. Mondal et al. [4] assessed the potential contribution of VRE to diversify the Philippines generation mix in meeting 2040 demands using a linear programming bottom-up model, The Integrated Market Allocation-Energy flow optimization model System (TIMES). The authors compared a business-as-usual reference 'case' against alternative policy scenarios, including the imposition of a carbon tax, RE target, limited coal share, and RE subsidy. Das et al. [5] also used the tool to explore possible future power supply scenarios for Bangladesh in 2045. These comprised high power imports, higher use of VRE, and a combination of both, aimed at reducing supply cost and fossil fuel imports while maintaining energy security.

Pupo-Roncallo et al. [6] used a deterministic model-based analytical programming tool, EnergyPLAN, to analyse the impact of integrated VRE on emissions and fuel consumption reductions across a range of Colombian 2030 electricity industry scenarios. Bamsile et al. [7] also used the same tool to model a year of supply-demand balance for Nigeria's electricity sector at hourly time-steps for a large number of sustainable energy scenarios, including different combinations of VRE technologies, pumped hydro-storage and gas. Dranka and Ferreira [8] used this tool for the case of a 2050 Brazilian electricity system using 100% renewables generation. Kumar and Madlener [9] applied an integrated modelling tool, Long range Energy Alternatives Planning (LEAP), to develop a model to examine the impacts of RE in the Indian long-term electricity supply mix and estimate the CO₂ emissions. The authors considered different level of RE capacity-based scenarios. Kachoe et al. [10] also used LEAP to simulate the supply side in baseline, slow-carbon, and RE based scenarios for Iran's future electricity demand in 2045. Mirjat et al. [11] applied LEAP to assess 2050 Pakistan's long-term electricity supply side scenarios by considering the reference case, RE based, maximum clean coal, and energy efficiency and

conservation scenarios.

Rady et al. [12] assessed the economic and environmental implications of possible Egypt's 2040 generation mix using a bottom-up, linear optimization model, the Open Source energy MOdelling SYStem (OSeMOSYS). The authors also tested the robustness of the scenarios through a sensitivity analysis. Dhakouani et al. [13] used the same tool to assess the potential benefits of increasing RE penetrations in the Tunisian electricity industry by 2030 through reference and targeted RE generation scenarios. Rego et al. [14] proposed a linear programming based-multiperiod optimization model to assess the impacts of different scenarios on the Brazilian electricity industry by 2033. The study focused on the demand growth and CO₂ target emissions and considering supply-demand seasonality and the peak period of demand. Afful-Dadzie et al. [15] developed a stochastic mixed integer linear programming-based model to solve electricity generation planning with and without RE targets for Ghana in 2030. The study analysed and compared scenarios findings around capacity additions, electricity demand met with RE, level of unmet demand, and electricity supply costs. Afful-Dadzie et al. [16] then applied the same method, in which focused on the setting and evaluation of 10% RE generation target policies and discussed their impacts on unmet demand and supply cost in Ghana by 2030.

These studies have certainly provided useful insights for policy makers regarding possible future electricity sector generation under different technology and cost assumptions and policy interventions. Less explored, however, has been the implications of different reliability targets of different options and, in particular, the potential trade-offs between reliability and costs.

Reliability in planning exercises is often 'set' through a constraint on unserved energy (USE). This may be set at zero reflecting that supply must always meet demand over the planning horizon. More sophisticated modelling often permits some fixed level of USE, perhaps matched to the target reliability for that jurisdiction. These targets reflect the reality that absolute 100.000% reliability can involve significantly higher industry costs given the additional generation and network capacity required to cover unexpected plant and network failures. Still, for developed countries these reliability targets are often very tight - for example, the Australian reliability standard is currently set at 0.002% USE [17]. Such targets reflect very high expectations on supply reliability and Value of Lost Load (VOLL) estimations, the USE price (\$/MWh) at which the cost of providing greater reliability starts to exceed the value of this reliability to consumers.

There is of course work exploring reliability-cost trade-offs in the electricity generation planning and operation context. Ghorbani et al. [18] optimized hybrid system scenarios using two algorithms: Genetic Algorithm-Particle Swarm Optimization (GA-PSO) and Multi-Objective Particle Swarm Optimization (MOPSO). While the authors aimed to obtain a hybrid system with the lowest cost and the highest reliability by conducting reliability/cost assessment and considering several operation reliability indices, the study was carried out in the off-grid context. Saboori et al. [19] applied a mixed-integer nonlinear programming with PSO algorithm in conducting an energy storage system (ESS) planning exercise to improve network reliability. While the study assessed reliability-cost trade-offs, in terms of energy not served (ENS) compared against the cost of ESS and total operation cost, including a sensitivity analysis, the study was focused on the radial electrical distribution network. Baghaee et al. [20] utilized a MOPSO algorithm

to solve reliability/cost based optimal design of a hybrid wind/PV with hydrogen storage system. While the study considered few operation reliability indices and one year period of hourly time steps operation, the analysis was done using a synthetical load data and for a micro grid.

Al-Shaalan [21,22] has discussed how reliability can be enhanced without compromising the affordability of the electricity system. While these studies have highlighted the important relationship between cost and reliability, they have been focused only on small grids without considering VRE penetrations nor other externalities such as emissions. These two aspects may significantly affect effective planning due to the trade-offs between security and economics. Röpke [23] applied a cost-benefit approach to analyse the trade-offs between RE development and supply security (reliability) targets on the German electricity market between 2010 and 2020. While the reliability levels are compared with its costs, the study focused on reliability problems of the distribution grid due to the increase of decentralised RE production. Wu et al. [24] applied Monte Carlo method to develop a stochastic long-term optimization-based model for calculating the cost of power system reliability. While the study considered trade-off between minimizing operating costs and satisfying reliability requirements, the analysis has been undertaken as a stochastic security-constraint unit commitment problem.

Our study adds new perspectives to existing studies by addressing two complexities for electricity generation planning studies that have not been fully explored to date. The first is that it explicitly explores the trade-off between future power system reliability and total generation costs, for electricity industries in emerging economies. While the very tight reliability targets generally used for modelling exercises are likely appropriate for developed electricity sectors with very high delivered reliability, many emerging economies achieve much lower reliability in practice. It is not uncommon for electricity users to suffer regular supply interruptions on near monthly, weekly, or even a daily basis. A 0.002% USE for future generation mixes misses the reality of these industry sectors. The second complexity is the implications of growing VRE penetrations on reliability. We model variable wind and solar PV generation with high temporal (hourly) and locational (choosing traces from a range of solar and wind locations) fidelity using an open-source evolutionary programming-based tool. While wind and solar now offer amongst the lowest levelized costs of electricity in many jurisdictions, their highly variable and somewhat unpredictable output raises additional reliability challenges to that posed by unexpected peak demand growth and conventional generator and network failures. Our study brings together two broad questions; appropriate system operational reliability standards, and the complexities of high VRE penetrations modelled at high temporal resolution on reliability, in the context of emerging economies' electricity industry planning.

In terms of methods, we compare the outcomes and computational effort of achieving different reliability outcomes through setting reliability as a constraint versus applying different prices on any USE. Finally, we consider how policy might drive higher VRE penetrations using carbon pricing, but with a particular focus on how industry costs should be assessed when such 'shadow' externality pricing and hence 'revenue' flows are utilized.

We demonstrate our approach for the case of Indonesia's future Java-Bali electricity grid. We use real data of hourly system demand of Java-Bali electricity grid, scaled to account for future demand growth, and conduct simulations to obtain optimum possible

future generation portfolios with high VRE penetrations under a range reliability standards and carbon prices and examine their impact on the associated generation costs and emissions. While we emphasize Indonesia and use the country as a case study, electricity supply reliability poses challenges for many other emerging economies, including those with relatively high rates of access, given the challenges of demand growth and raising the capital required for investment to meet this [25,26]. Therefore, while we use the Indonesian electricity industry as our case study, the method used, and insights obtained from the analyses presented in this paper are highly relevant to other jurisdictions with similar contexts.

It is important to note here that the reliability of electricity provision has enormous significance for energy users - residential, commercial, and industrial - and that the private and broader societal costs of relatively poor reliability in many emerging economies are poorly understood but likely large. Also, the reasons for supply interruptions may have many causes other than insufficient generation capacity, often relating to grid overloading or failure. Such realities mean that many industry, commercial and even residential participants have sought self-supply options to cover grid outages, and major cost additions to improve reliability may prove challenging for many consumers. In particular, we are not arguing that electricity consumers in these jurisdictions wouldn't value greater reliability, but rather acknowledging the realities of achieved reliability at present and seeking to better understand potential cost-reliability trade-offs. Work to better understand the impacts of different levels of reliability on the demand-side is beyond the scope of our study, but clearly needed.

The rest of this paper is organized as follows. In Section 2, we briefly discuss the emerging economies' contexts for electricity industry planning, focussing on Indonesia's power sector as the selected case study, and other important aspects. Section 3 describes the method applied in this study, simulation overview, scenarios and assumptions, and the data inputs for our scenario modelling. Results and discussions are presented in Section 4, and finally, Section 5 concludes the paper.

2. Emerging economies' context for electricity industry planning: a case study of Indonesia

Electricity industries in many emerging economies are characterized by having significant demand growth hence investment challenges, and a present reliance on fossil-fuel generation despite excellent renewable resources, including VRE. This section presents an overview of the current Indonesian power sector situation, especially for the main Java-Bali grid, given its high relevance to many other electricity industries in other emerging economies in terms of underlying resources, present fossil fuel reliance, investment challenges and policy gaps for transitioning towards a more sustainable future.

2.1. Power sector profile and long-term generation planning

Perusahaan Listrik Negara (PLN), a state-owned vertically integrated utility, is responsible for managing the entire electricity industry value chain including generation, transmission and distribution, and retail in Indonesia. Total national electricity installed capacity and electricity production in 2018 was 57.8 GW and 257.5 TWh, respectively, of which 27.9% of the total installed capacity and 30.4% of the production came from Independent Power Producers (IPPs) [27]. While IPPs' contribution continues to

increase in supporting government target on 100% electrification, many areas in Indonesia still experience poor electricity supply reliability. Some of the reasons include supply shortages and a combination of several factors such as operation and maintenance challenges, lack of network capacity, ageing assets, and theft [28].

The Java-Bali grid is the largest interconnected electricity network in Indonesia, serving around 60% of the total country's population. In 2018, electricity consumption and peak load in this region were reported as 165.8 TWh, or 71.4% of the total national electricity consumption, and 27 GW, respectively [27]. Generation capacity was 37.7 GW, including 7.7 GW capacity contributed by IPPs [27]. Coal dominates Java-Bali's PLN generation mix representing 54.5% of total capacity, followed by gas (35%), hydro (8.1%), geothermal (1.26%), and diesel (1.07%) [27]. Despite having the highest electrification rate among Indonesian regions, around 600,000 households in Java-Bali were reported without access to electricity in 2018 [28].

Indonesian electricity industry expansion planning, including electricity infrastructure and investment requirements, is technically undertaken by PLN. The planning has been made based on the national energy policy established by the government and other related advisory agencies, including the Indonesian National Energy Council (DEN), and the parliament. According to the PLN's 2019–2028 plan, electricity produced from coal will still dominate the generation mix in Java-Bali (including insignificant share of Nusa Tenggara) in 2028 [29]. The mix will be coal (57.4%), followed by gas (24.6%) and combination of RE (17.6%), mainly consisting of hydro (6.5%) and geothermal (8.3%). The plan also suggests that significant development of RE-based capacity other than geothermal and hydro will not become priority despite the rapidly falling price of solar PV, an excellent solar resource, and some untapped wind generation potential.

While an electricity generation mix, mainly based on fossil fuels has been projected for the major grid systems in 2028, which satisfies the reserve margin target along with planning around RE-based capacity [29], the latest Indonesian electricity industry outlook indicates a different projection for 2050 in its Business as Usual (BAU) scenario [30]. Nationwide, RE technologies are expected to achieve 46.8% capacity share, followed by coal and gas with 27.6% and 25.5% capacity share, respectively [29]. Apart from these two contrasting projections, important indicators in the planning comprising both short and long-term system reliability are not well addressed. As also presented in the PLN's projection, the impact of available RE policy instruments on the future generation mix is arguably not well addressed. Furthermore, future uncertainty associated with, for example, the costs of different generation technologies and fuel resource availability is not assessed.

2.2. Coal domination among key challenges

Indonesia's electricity industry requires more attention from stakeholders and policymakers. PLN's financial limitations has been one of the barriers to planning for future generation mix. PLN is currently not financially viable due to the chronic and significant gap between its operating expenses, including high generation costs and debt on capital, compared to its operating revenue [31]. PLN (and hence the government) are also facing a serious risk of coal lock-in due to capacity obligation agreement to coal IPPs.

Government electricity subsidies have been key to correcting PLN's financial circumstances and enabling the company to record positive yearly income.

Regulatory settings themselves do not always support to achieve the planning targets. As a result, the planning process is perceived as flawed for reasons including its lack of transparency, and the targets for capacity expansion are not being followed through [31]. For example, there is the apparent neglect of any meaningful strategy to incorporate increasingly cost-effective VRE options in the 2018–2027 plan [31]. Moreover, the plan includes only a minor role for solar PV despite global cost trends. While large-scale solar PV and wind are forecasted to be the most economic new-build options in near future and reshaping the generation mix in many emerging economies, it seems to currently be overlooked in Indonesia.

Indonesia's electricity generation mix has been dominated by coal as the country is one of the biggest coal producers and exporters in the world. Coal has been perceived as a cheap energy source for Indonesia because its externality cost in the long-term planning has not been considered. The government introduced coal price cap policy, currently set at US\$ 70 per tonne, in addition to 25% domestic market obligation to keep electricity tariffs low and preserve its availability for domestic use [32]. As consequence, the competitiveness of solar and wind is weakened by this artificial pressure of domestic coal pricing. Under current economic circumstances, the burden of coal IPPs are rising as domestic coal demand is projected to increase due to additional coal-based generation capacity planned until the next decade.

Major key barriers to the transition from coal into large-scale adoption of VRE in Indonesia can be multi-dimensional, of which many of them are related to coal. These include a strong market position of coal, regulatory settings that support the coal industry, subsidies on electricity pricing and fossil fuels including Indonesia's coal price cap, an investment appetite for funding coal-fired power plants, avoidance of considering externality costs, unfavourable regulation on renewables, grid management challenges, and only limited political support for renewables, among other [33,34].

While Indonesia has committed to reducing its greenhouse gas emissions to 29% of the BAU level in 2030 or up to 41% with international assistance, the country requires more VRE especially solar and wind in addition to hydropower and geothermal. VRE progress has been recognized to be slower than planned. Solar PV and wind generation capacity were just below 0.1 GW in 2018, and their total additional capacity are planned only up to 0.9 GW and 0.85 GW in 2019–2028 plan. This is also an example of how the PLN 10-year plan for so many years has aimed at generation planning that shows a chronic reliance on 'artificially cheap' domestic coal amid the competitiveness of solar and wind in terms of both costs and emissions reductions.

This all suggests a need for more transparency/participation in planning by a wider range of stakeholders. Indonesia, and other jurisdictions with similar context, should rethink commitment to plants that involve rapid expansion of coal capacity given various international pressure and growing investor unwillingness to take on exposure to coal. Consequent with this, is a need to better understand the range of options, particularly with high RE penetrations, and their potential implications for both costs yet also reliability.

3. Method

Our study considers future electricity generation scenarios with high VRE penetrations, for Indonesia's Java-Bali grid capturing the complexities of Java-Bali solar and wind generation potential in terms of their hourly output variability and uncertainty (see Section 3.5 for more details), as well as Java-Bali hourly dynamic system demand (see Section 3.4 for more details) for a future year 2030. Appropriately capturing these dynamics in long-term generation planning, including renewables supply and system demand, requires use of a chronological dispatch model (tool).

We firstly use an open-source stochastic optimization tool (see Section 3.1 for more details) as a dispatch model to solve possible optimum (least-cost) generation portfolios and their parameters, subject on a range of system reliability targets and different carbon prices (CP) under high VRE penetrations. We particularly use two different approaches (hereafter methods) on how a wide range of reliability standards is put in the optimization (see further in Section 3.2). Techno-economic and demand data, and assumptions for our case study are also presented.

3.1. Simulation overview

We use an open-source evolutionary programming-based techno-economic optimization model, the National Electricity Market Optimiser (NEMO) [35] to obtain least-cost generation portfolios, including generation capacity mix, total generation cost, and CO₂ emissions, among other parameters. Fig. 1 shows the optimization framework and relationship between input-output in NEMO.

NEMO performs a stochastic optimization strategy, the Covariance Matrix Adaptation Evolution Strategy (CMA-ES), based on the evolutionary programming approach called Distributed Evolutionary Algorithms in Python (DEAP) [35]. In NEMO, the CMA-ES finds the least-cost capacity mix subject to several constraints and resource limitations, such as reliability standards, generators capacity build limit, and environmental factors including CP and emissions limit.

NEMO has been used in a diverse and growing number of studies on the electricity industry planning with high RE, including to find the least-cost 100% future renewable electricity system in Australia's National Electricity Market [37,38], and to compare the cost obtained by these systems with lower emissions fossil fuel-based systems, including gas and coal with carbon capture and storage [39], among others. NEMO also has been applied in some studies on Indonesia's Java-Bali grid future generation portfolios,

such as to explore least-cost high RE portfolios using scenario analyses [40], to investigate the role of large-scale PV towards the least-cost systems given technology costs, demand levels, and fuel cost scenarios [41], and in a study on the key trilemma's metrics clustering based assessment of cost, security and environmental trade-offs considering possible future generation portfolios [36].

3.2. Methods for incorporating reliability in the optimization algorithm

Modelling long-term electricity industry planning for our study also requires inputting reliability of supply parameters. In this study, we use two different methods to represent reliability in the optimization algorithm. In the first method, reliability is represented as an optimization constraint by setting a certain value of USE applied for a whole year of simulated operation. We use the term USE to represent the level of grid reliability. It is expressed as a percentage of total unserved load over the total system demand in a year, given hourly traceable generation supply and demand resolution. Nevertheless, it should be noted that other reliability parameters might also be applied for electricity industry planning and operation purposes in different countries. We consider eight different USE limits, i.e. 0.005%, 0.05%, 0.5%, 1%, 2%, 3%, 4%, and 5%, and impose these fixed USE limits as hard maximum limits on the allowed USE.

Another approach is to place a typically very high penalty or 'Value of Lost Load' (VLL) price (\$/MWh) to any USE so that the cost minimization sets USE at the efficient level where the cost of increasingly reliability is not worth the value of this reliability to end consumers. In practice, setting these reliability targets or penalty prices involves some sense of this trade-off between reliability and cost. In the second method, therefore, we apply different penalty costs/prices (\$/MWh) for the USE. The purpose of applying this method is to provide an alternative way of getting the least-cost generation mix for different levels of reliability without having a predetermined USE constraint imposed into the simulations.

The reliability cost component represents the amount of cost \$/MWh that is borne by the system as a penalty for not meeting a MWh demand. We effectively 'tune' this penalty charge through iterative runs of NEMO until we achieve delivered %USE outcomes equivalent to those we test (ranging from 0.005% to 5%) when setting this as a constraint.

While in this study we use %USE to represent the level of grid supply reliability in an hourly supply-demand resolution, it is calculated over the planning horizon, for example a certain year in the future. We do not assess or incorporate reserves margins (e.g.,

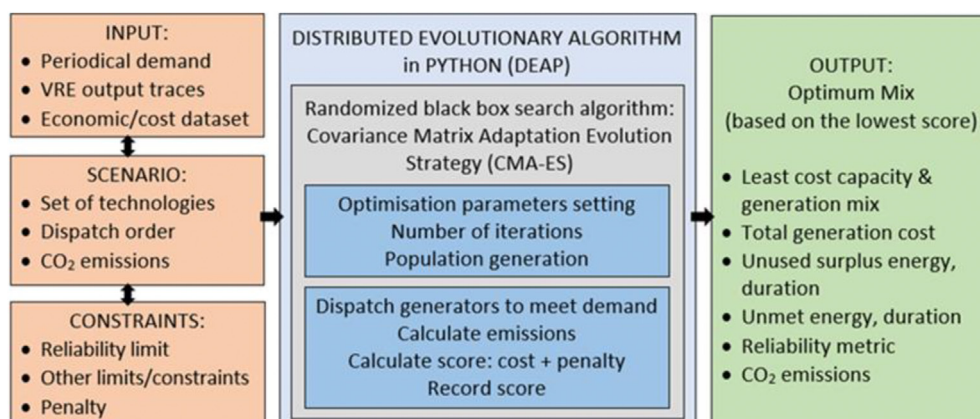


Fig. 1. The optimization framework and relationship between input-output in NEMO [36].

an operating reserve requirement of capacity above peak demand) into the analysis as is sometimes done in these types of studies. NEMO can actually model this and the implications of reliability level, as measured by USE target, on dynamic operating reserve margins are discussed in Tanoto et al. [42]. However, it lies beyond the scope of this study.

3.3. Scenarios, parameters, and assumptions

We consider different carbon prices (CP) as a proxy for a potentially wide range of policies that could deliver greater future VRE penetrations. Our chosen prices are \$0/tCO₂ (CP0), \$35/tCO₂ (CP35) and \$60/tCO₂ (CP60) – to reflect possible Indonesia's future policy settings on emissions reduction commitments, as well as also representing some other uncertainties around future fuel costs and cost for funding increasingly risky fossil fuel projects [40]. We use a 5% discount rate on annualized technology capital cost and a maximum permitted non-synchronous penetration of 0.75. Coal and gas prices are assumed at \$3.5/GJ and \$10.9/GJ, respectively, following [43].

Total industry generation costs are observed either in \$/total MWh of demand or \$/MWh of actual energy served, and according to the treatment of carbon revenue (CR) – included in total industry costs or not. In terms of analysis on emissions outcomes, we also use tCO₂/MWh energy served as an indicator to measure the environmental outcomes of different generation portfolios. We do not model transmission networks and other related investment requirements.

3.4. Demand data

Located in a tropical climate region with warm and humid air throughout the year, the Java-Bali region load profile is characterized by only small changes in terms of monthly highest and lowest hourly peak load. The dry season normally occurs around June to November followed by a wet season from December to May. Annually, minimum loads are mostly associated with the largest religious festivity periods in the country and extend over approximately a week or two before and after the observed day due to long holidays. This study uses 2015 hourly demand data of the Java-Bali grid [44] as a baseline, as shown in Fig. 2 (left). Besides, the highest and the lowest daily load profile are also shown in Fig. 2 (right).

We consider a single value of growth rate as this study focuses

more on the solution space analysis of the results obtained from the least-cost mix simulation framework rather than just to compare optimal solutions of different demand scenarios. An arguably conservative linear annual growth rate of 5% is assumed in this study to create a projected 2030 demand profile based on the 2015 baseline, considering historical average annual growth in the region [36], yet also the slowing down of national economic growth in the past few years, unmet targets for national generation expansion and the uncertainty in the global future economic outlook and vulnerability of emerging economies against global energy commodities. As consequence, the modelling sees an energy demand profile of 346.5 TWh and 50 GW peak load by 2030.

3.5. RE generation potential data

We use the one-year of gridded hourly solar power output data for the same year (2015) from Renewables Ninja (RN), an online RE simulation tool [45]. By providing the tool with primarily a specific location and the tilt angle according to the location's latitude, the hourly time-step output of RN – based on 1 MW plant capacity – is modelled using the Global Solar Energy Estimator based on NASA MERRA2 direct and diffuse radiation and ground temperature data [45].

We follow the methodology used in the previous study [36,41], as up to 6 locations are assigned a PV plant candidate trace, one location in each province covered by the Java-Bali grid, considering factors such as high-capacity factor, low hourly temporal variability and low spatial variability in addition to the terrain and proximity with volcanoes. Hourly wind power output traces for selected locations for the year 2015 are obtained from RN as well. Locations assigned for wind plant candidates are chosen using the Indonesia wind prospecting map [46]. Despite the potential capacity of solar and wind mentioned for the Java-Bali grid in the literature [43,47,48], PV and wind build capacities are not capped in this study considering high uncertainty of their potential output. Meanwhile, build limits for geothermal and hydro are set at 10 GW and 8 GW, respectively, based on [43,47].

3.6. Technology costs data

We consider three fossil fuel-based technologies – coal fired power plant, combined cycle gas turbine (CCGT) and open cycle gas turbine (OCGT), and five candidates of portfolios from renewables,

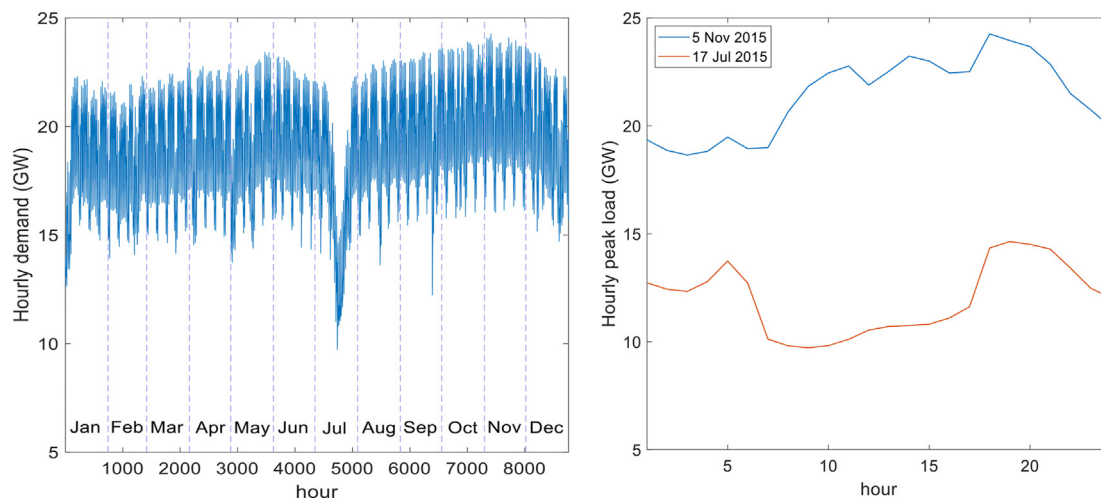


Fig. 2. The 2015 hourly demand of Java-Bali grid (left) and the corresponding highest and the lowest daily load profile (right).

Table 1
Mid-level 2030 technology cost components.

No.	Technology	Capital (\$/kW)	Fixed O&M (\$/kW-year)	Variable O&M (\$/MWh)
1.	Coal	1360	35.8	3.8
2.	OCGT	400	22.5	3.8
3.	CCGT	710	22.5	3.8
4.	Biomass	1600	43.8	6.5
5.	Geothermal (Geo)	3200	16.7	0.7
6.	Hydro	2000	35.8	3.8
7.	Wind onshore	1310	52	0.8
8.	Solar PV fixed	610	12.5	0.4

i.e., geothermal, hydropower, biomass, PV, and wind. We use mid-level 2030 technology costs scenarios, compiled from reports published by Indonesia National Energy Council [49,50] after further comparison and verification against other costs dataset [51–54]. The technology cost components used in this study are presented in Table 1 [36].

We are aware that the results presented in this paper, i.e., analysis around cost-reliability trade-offs and its implications toward the changes in capacity and generation mix depend greatly upon the technology costs assumed for this assessment. In recent years, the costs of some mature RE technologies such as PV and onshore wind have significantly decreased [55]. The current range of generation cost for fossil fuel capacity in Indonesia is about \$75–150/MWh while weighted average levelized cost of electricity from major VRE technology such as wind onshore, hydro, and geothermal are already within that range, except for PV [43]. Therefore, significant changes in technology costs especially for RE could change the specific results of these analyses, mostly in terms of making VRE more attractive.

4. Results and discussions

In this section, we present and elaborate specific results for the Java-Bali grid case study. Initially, we show and describe results for the default case as shown in Section 4.1, followed by results on the possible optimum generation capacity portfolios, as obtained from the simulations using method 1 (Section 4.2) and method 2 (Section 4.3), and findings around CO₂ emissions outcomes (Section 4.4).

We model our future generation scenarios problem in two ways; first by treating USE in one set of modelling as an exogeneous

constraint input, and then secondly as a cost associated with any USE. In this section we compare the results and computational ease of both approaches, while focussing on the actual reliability and cost trade-offs.

4.1. Default case

We first assess least cost 2030 Indonesia's Java-Bali generation portfolios as a default case by imposing a single fixed reliability constraint of 0.002% USE as our baseline scenario. We apply this relatively high reliability standard as it is currently the Australian National Electricity Market standard [17]. The generation technology candidates are shown in Table 1. We apply three-CP scenarios – no CP or CP0, \$35/tCO₂ or CP35, and \$60/tCO₂ or CP60. The optimum solutions are found for all CPs using NEMO as briefly described in earlier section. The least-cost capacity and generation mix of the default case with and without CPs are shown in Fig. 3.

The results highlight that while Geothermal and Hydro capacity hits its maximum allowed GW for all CP scenarios, the higher CP drives more PV (and at CP60 wind) as well as greater CCGT capacity additions. The share of RE including VRE in the generation mix increases from 54% to 64% and 71% in CP35 and CP60, respectively. On the other side, coal share decreases from 46% in CP0 to 33% and 18% in CP35 and CP60, respectively.

While imposing CPs would see higher generation costs due to the additional cost associated with cleaner technologies as well as the direct carbon cost, the collected revenue (CR) from imposing CPs can be used to provide cross-subsidies to groups of consumers who are most vulnerable to higher price of electricity due to this scheme and also for other social welfare purposes. Therefore, the total costs of industry excluding the carbon revenue (CR) are also

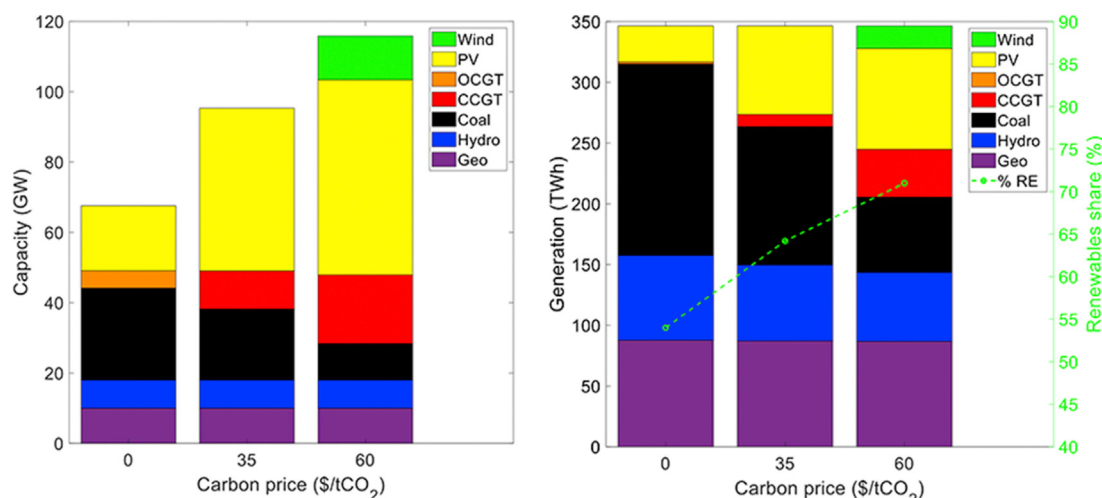


Fig. 3. Capacity (left) and generation mix (right) of the least cost default planning with CP0, CP35, and CP60.

Table 2

Total cost, simulated USE and VRE share using 0.002% USE as reliability constraint.

CP in \$/tCO ₂	Total cost incl. CR in b\$/year	Total cost excl. CR in b\$/year	Simulated USE in percentage	VRE share in percentage
0	14.0	14.0	0.002	8.6
35	18.3 (30.7% ^a)	14.3 (2.1%**)	0.002	21.0
60	20.9 (49.3% ^a)	16.4 (17.1%**)	0.002	29.3

^a Cost changes between the total cost obtained in the simulation involving CP35 and CP60 versus CP0; **Cost changes between total costs after taking carbon revenue out.

estimated. Variations in terms of the total cost exclude CR, simulated USE, and the share of VRE among the optimum capacity mixes for all CPs are presented in Table 2.

From Table 2, carbon revenue for CP35 and CP60 can be calculated to be b\$4/year and b\$4.5/year, respectively. Interestingly, almost doubling the CP has only a modest increase in carbon revenue given that it drives greater deployment of PV, wind, and gas generation. CO₂ emissions fall in CP35 and CP60 from 154 MtCO₂ in CP0 to 114 MtCO₂ and further to 76 MtCO₂, respectively.

As noted above, achieving a relatively high-reliability level is difficult in developing countries. Therefore, this study also considers lesser reliability standards to explore the optimum solution space in terms of a possible range of costs and acceptable reliability settings in the presence of high VRE penetrations. In following sections, we present results obtained from the simulations using two different methods in the optimizations, as described earlier.

4.2. Method 1: fixed USE limit

Considering a range of reliability levels, our assessment shows that, as expected, the total generation costs of the optimum (least-cost) portfolio mixes decrease as lower reliability standards imposed. In all simulations without CP, the total generation costs decrease from b\$14/year to b\$12.1/year, or a 13% reduction, associated to 0.005% USE and 5% USE, respectively. With the same reliability range, the costs in CP35 are reduced from b\$18.4/year to b\$16/year, or also a 13% reduction. In CP60, the costs are decreasing from b\$20.9/year to b\$18.2/year, also equivalent to a 13% reduction. Thus, all simulations produce around 13% cost reductions from the highest to the lowest reliability standards. It should be noted that CR is included in all results.

Fig. 4 (left) presents plots of the total generation costs,

expressed in b\$/year, for all optimum generation mixes versus USE for all CPs. Besides, it shows the cost trend if CRs are excluded from the total costs obtained in CP35 and CP60. A comparison between total generation costs, expressed in \$/total MWh and \$/MWh energy served versus USE is presented in Fig. 4 (right), either with or without CR embedded in the costs.

The fall in total industry costs through relaxing the reliability standard is significant in terms of total industry costs and average \$/MWh costs. As expected, \$/MWh-served cost reductions are less as USE increases given that less MWh are actually delivered. A higher difference between \$/total MWh and \$/MWh served is observed as reliability is further relaxed. Costs reduction expressed in b\$/year and \$/MWh served are presented in Table 3, highlighting relatively similar cost reductions across all the three CP scenarios.

For CP0, the total system cost decreases from b\$14/year to b\$12.1/year as USE limit drops from 0.005% to 5%. In other words, there would be around b\$0.38/year on average that might need to be spent to increase the system reliability by 1%, with additional costs at around b\$0.48/year and b\$0.54/year for CP35 and CP60, respectively.

Fig. 5 shows the capacity and generation share of different technologies under different USE limits for CP0. PV capacity grows from 23 GW to 31 GW as reliability is relaxed to 5%. Coal capacity on the other hand reduces from 27 GW to around 18 GW. OCGT appears only in less than 0.05% USE which highlights the role of this peaking plant in meeting the rare peak times which could have been unserved with a lower reliability limit. In the generation mix (right figure), RE penetrations increase from 56.4% to 61.6%.

In simulations with CP35 (as shown in Fig. 6), some gas-based generation exist up to a 2% USE limit. At the USE target is relaxed, OCGT is displaced by CCGT then by VRE. Energy generation from coal is decreased around 22% and 20% at 0.005% and 5% USE limit,

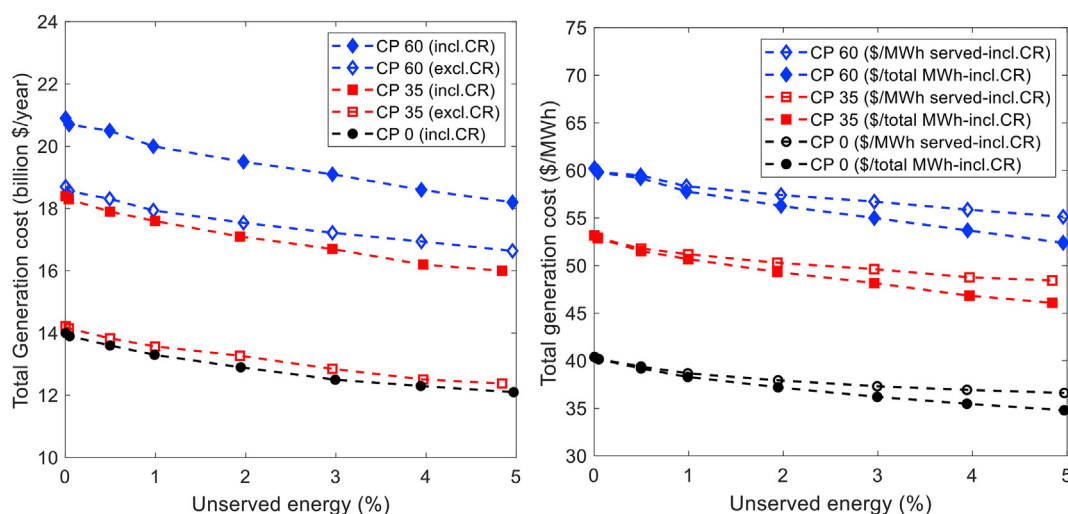


Fig. 4. Total generation costs versus realized USE, expressed in b\$/year (left), and total generation costs versus realized USE, expressed in \$/total MWh and \$/MWh served (right), for all CPs.

Table 3
Cost for the highest and the lowest reliability level, expressed in \$/year and \$/MWh served.

CP (\$/tCO ₂)	Cost incl. CRs (b\$/year)			Cost incl. CRs (\$/MWh served)		
	0.005% USE	5% USE	Cost reduction (%)	0.005% USE	5% USE	Cost reduction (%)
0	14.0	12.1	13.5	40.39	36.62	9.3
35	18.4	16.0	13.0	53.17	48.44	8.9
60	20.9	18.2	12.9	60.24	55.13	8.5

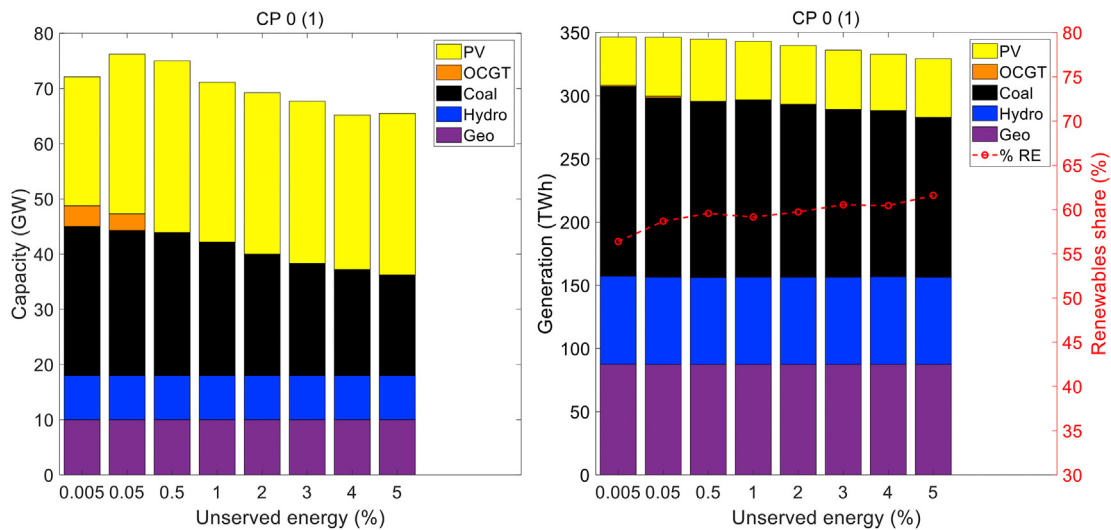


Fig. 5. (Left) Capacity mix and (right) corresponding generation mix and the trend of RE share of the optimum future mix by allowing different USE limits imposed as reliability constraint and CP0.

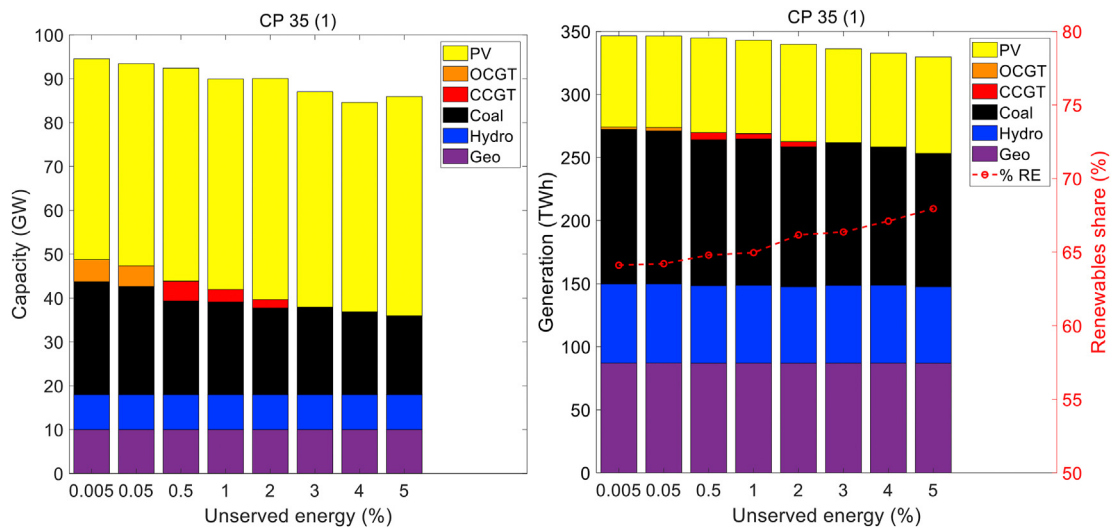


Fig. 6. (Left) Capacity mix and (right) corresponding generation mix and the trend of RE share of the optimum future mix by allowing different USE limits imposed as reliability constraint and CP35.

respectively. A higher capacity of PV is obtained at this CP compared to CP0. For 0.005% and 5% USE limit, PV capacity reaches 45.78 GW and 49.97 GW, respectively. As seen in Fig. 6 (right), RE shares for the highest to the lowest reliability range from 64.11% to 67.95% while VRE shares are 20.87% at 0.005% USE limit and increase up to 23.17% at a 5% USE limit.

In CP60, the majority of coal capacity in the optimum mixes across all reliability standards are replaced by CCGT, in addition to extensive solar and wind penetrations. We find a relatively similar PV capacity of 50 GW for all reliability levels while wind capacity doubles from 14.4 GW at 0.005% USE limit to 31.8 GW at a 5% USE limit, while coal capacity exist only at 0.005% and 0.05% USE limit. As depicted in Fig. 7 (top), RE generation shares increase roughly 10.5% from 0.005% to 5% USE limit.

4.3. Method 2: priced USE

In this section we present findings obtained using method 2 and their comparison with those revealed from simulations using method 1. To permit comparison we tune the penalty price on USE \$/MWh so that the optimization delivers the USE targets used in method 1. For example, the realized cost of USE of \$68/MWh delivers 5% USE. The tuned costs of USE along with the corresponding USE levels are shown in Fig. 8 (left). For generation costs with CR included, the costs obtained from method 2 are similar to those using method 1 when excluding the realized penalty cost component. A comparison between generation costs obtained from both methods is presented in Table 4.

Results obtained from the simulations using method 2 without CP are presented in Fig. 8 as an example for comparison purposes against method 1 (results for CP35 and CP60 are shown in the appendix).

Our analysis shows that NEMO was able to solve the same costs and generation mix modelling reliability through either a fixed USE constraint or by pricing USE in the cost minimization function. As noted in Section 3.2, this involved a ‘tuning’ process where we ran NEMO with different penalty costs (\$/MWh) until it delivered USE% broadly equal to the range of USE we tested using the constraint approach. The penalty price approach does have one particular advantage for evolutionary computation, where hard constraints can cause challenges for the evolutionary process in trying to get as close as possible to, while not exceeding, this reliability target. As shown in Fig. 8, this method tends to provide a smoother trend of capacity mix outputs. Still, similar results of RE generation shares in the optimum generation mixes using method 1 and method 2 are achieved, as shown in Table 5.

Given the easier and more stable computation using penalty pricing rather than hard constraints, our findings suggest that it might be the preferred approach for modelling reliability and cost trade-offs with evolutionary programming. Other solution approaches such as LP may of course exhibit different behaviour across these two approaches.

4.4. CO₂ emissions outcomes

Total CO₂ emissions obtained from method 2, expressed in MtCO₂ and tCO₂/MWh served, across simulated reliability standards are shown in Fig. 9. The total amount of CO₂ emissions in CP0 is decreased from 146.4 MtCO₂ at 0.005% USE limit to 122.2 MtCO₂

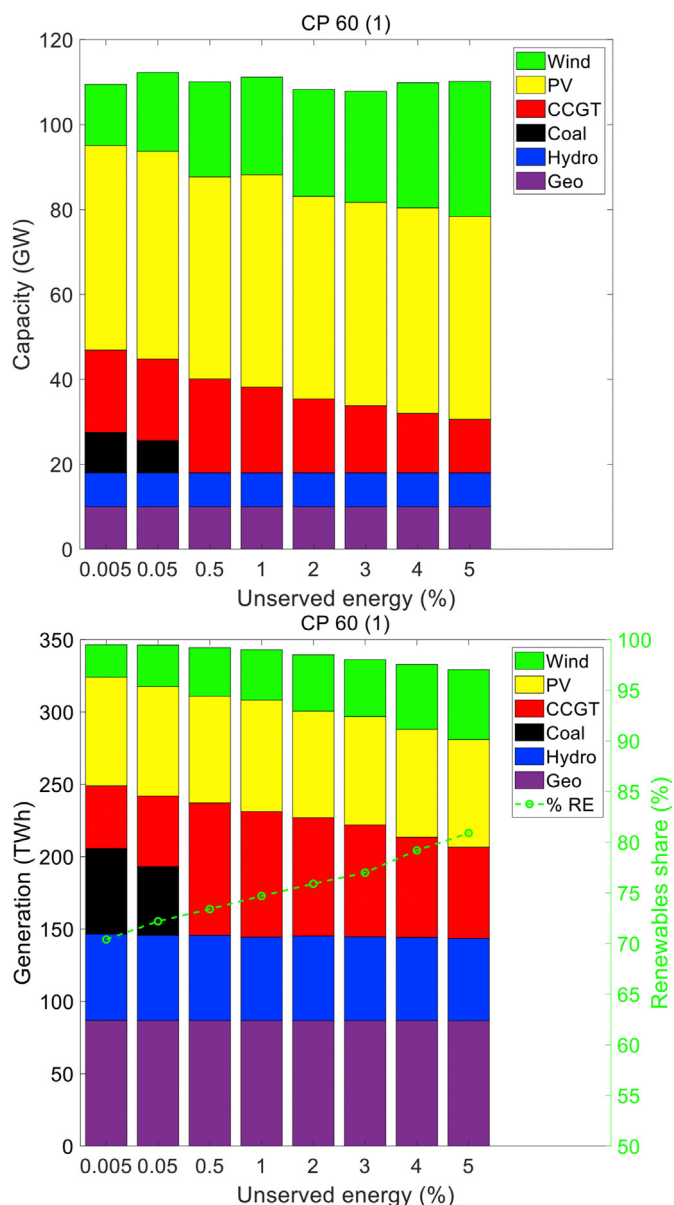


Fig. 7. (Top) Capacity mix and (bottom) corresponding generation mix and the trend of RE share of the optimum future mix by allowing different USE limits imposed as reliability constraint and CP60.

at 5% USE limit which is around 16.5% decrease. CP35 scenario shows a similar level of emissions reduction in terms of percentage from 120.2 MtCO₂ to 102.4 MtCO₂.

The downtrend of the total emissions due to larger USE level is shown by the dashed black lines. A significant drop in CO₂ emissions is obtained in CP60 from 72.9 MtCO₂ to 26.2 MtCO₂, equivalent to a 64% drop. A similar declining trend is also observed in tCO₂/MWh energy served (dashed-red lines), suggest how reducing reliability requirements not only reduces total and \$/MWh industry costs but also CO₂ emissions. The largest reduction is obtained for CP60, in which CO₂ emissions are falling from 0.21 tCO₂/MWh to

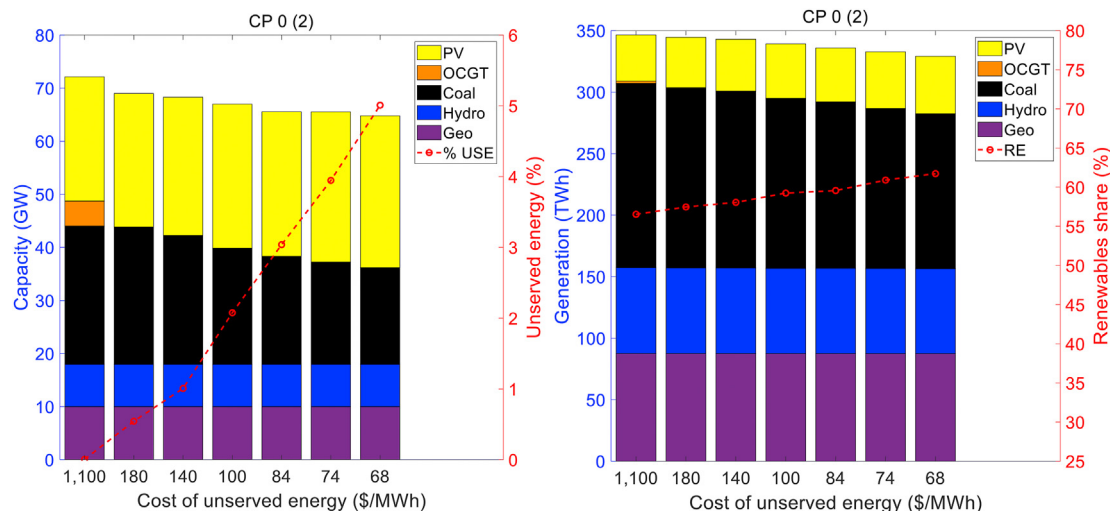


Fig. 8. (Left) Least cost capacity mix and corresponding USE and (right) least-cost generation mix and RE shares for CP0.

Table 4

Comparison of generation cost of the least cost portfolios mix including CR (in b\$/year).

USE level (%)	Method 1			Method 2 ^a		
	CP0	CP35	CP60	CP0	CP35	CP60
0.005	14.0	18.4	20.9	14.0	18.4	20.8
0.5	13.6	17.9	20.5	13.5	17.8	20.3
1	13.3	17.6	20.0	13.3	17.5	19.9
2	12.9	17.1	19.5	12.8	17.0	19.4
3	12.5	16.7	19.1	12.5	16.6	18.9
4	12.3	16.2	18.6	12.3	16.2	18.5
5	12.1	16.0	18.2	12.0	15.8	18.1

^a Realized penalty cost component is excluded. The total cost of the industry and penalty cost component is presented in Appendix (Table A).

Table 5

Comparison of RE generation shares in the optimum generation mixes (in %).

USE level (%)	Method 1			Method 2		
	CP0	CP35	CP60	CP0	CP35	CP60
0.005	56.4	64.1	70.4	56.5	64.0	70.6
5	61.6	68.0	80.8	61.7	67.9	80.1

0.08 tCO₂/MWh, or around 62%.

In summary, our modelling results suggest that using lower reliability standards in generation planning might not only reduce total \$/year and average \$/MWh industry costs, but it can also facilitate greater VRE deployment and consequent emissions reductions. Imposing a CP can also greatly reduce emissions and the industry cost increases may not be as significant as feared as long as the special nature of carbon revenues are appropriately factored into the analysis. The emission outcomes of Fig. 9 highlight the potentially major opportunity to deliver much lower industry emissions through CP and more relaxed reliability standards.

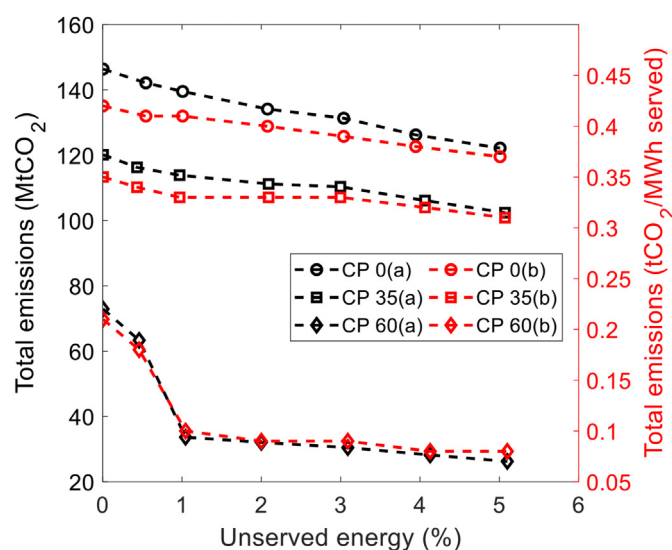


Fig. 9. Total CO₂ emissions of least-cost mixes (dashed-black colour lines), and CO₂ emissions per MWh served (dashed-red colour lines) versus realized USE for all CPs using method 2. (For interpretation of the references to colour in this figure legend, the reader is referred to the Web version of this article.)

5. Conclusions

Electricity industry planning in emerging economies is an enormously challenging task given the need to meet growing demand despite challenges in financing investment. Poor reliability outcomes often result, while adverse environmental impacts are, understandably, not given great weight. Wind and solar PV offer extraordinary potential to assist these electricity industries to meet growing demand at reasonable cost whilst greatly improving

environmental outcomes.

Our study provides new perspectives on these challenges by exploring the implications of different reliability standards, including relatively high USE, on generation costs for future electricity generation mixes with high VRE scenarios. While we undertake long-term planning, we also model variable wind and solar generation with very high temporal (hourly) and locational (choosing traces from a range of solar and wind locations) fidelity. Our methods compare different reliability outcomes through imposing reliability as a constraint versus applying different prices on any USE. We also consider the use of carbon pricing to encourage higher RE penetrations and utilize 'shadow' externality pricing and hence 'revenue' flows in our analysis.

While the broad topic of reliability-cost trade-offs for future electricity generation scenarios has, of course, already received considerable attention in the literature, reliability targets has typically been fixed at very high levels in electricity generation planning exercises. In addition to imposing reliability as a constraint, our study explicitly prices the impacts of different reliability targets, in the context of emerging economies where electricity industry reliability is often significantly lower than that achieved in industrialized economies, and with high VRE penetrations. Our study brings together two broad issues, i.e., appropriate operational reliability standards and the complexities of high VRE penetrations in the context of emerging economies' electricity industry planning.

We applied these methods to assess possible optimum generation capacity portfolios for different reliability levels and CPs for the Java-Bali grid. The simulation results using both reliability methods exhibit similar results in terms of increasing penetration of RE, including VRE, notable reduction in total generation costs, and a wide span of CO₂ emissions reduction, although placing reliability in the cost function rather than constraint set would seem to offer computational advantages.

Our results show a similar 5%–10% increased renewables share as CP increases by relaxing the reliability target from 0.005% USE to 5% USE. The least cost generation mix has 60%, 68%, and 80% renewables share at 5% USE for CP0, CP35, and CP60, respectively. Meanwhile, cost reductions (in \$/year includes carbon revenue) of around 13% are obtained across all CP scenarios when shifting from 0.005% USE to 5% USE in the first method. This equivalent to a cost reduction of around 9% in \$/MWh served. While CO₂ emissions reductions from greater VRE deployment are seen as %USE increases, imposing CP can significantly help to further reduce total CO₂ emissions in terms of both MtCO₂ and tCO₂/MWh served.

We do not conclude that emerging economies should target lower reliability levels than industrialized economies. However, we do highlight the potentially significant overall industry cost reductions associated with lower reliability targets. Future work is, however, required to better understand the implications of this for electricity consumers in emerging economies, noting that they generally experience far lower reliability than consumers in industrialized economies.

Our study also does not explicitly model system flexibility beyond the generation mix service a year of simulated hourly demand. Still, the resulting generation mixes feature significant gas-

fired generation which can flexibly respond to changing VRE availability [41].

While our specific findings are relevant to the Java-Bali electricity grid, the approaches used in this study have broader relevance for electricity industries in other jurisdictions given similar contexts, particularly for planners and policymakers in examining the impact of different reliability settings on the economics of different generation capacity expansion pathways. A more flexible approach to reliability targets not only can reduce total generation costs but also support greater use of VRE technologies.

CRediT author statement

Yusak Tanoto: Conceptualization, Methodology, Software, Formal analysis, Visualization, Writing – Original Draft. **Navid Haghdadi:** Visualization, Software, Writing – Review & Editing. **Anna Bruce:** Writing – Review & Editing, Supervision. **Iain MacGill:** Writing – Review & Editing, Supervision.

Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

Acknowledgements

This work is part of the study supported by funding from the Indonesia Endowment Fund for Education (LPDP) Scholarship provided by the government of the Republic of Indonesia under contract number: PRJ-3167/LPDP.3/2016. We thank PLN for providing Java-Bali electricity grid 2015 hourly demand data.

Appendix

Table A
Total cost of industry and penalty cost of the least-cost mix using method 2 (in b\$/year)

USE level (%)	CP0		CP35		CP60	
	Total cost	Penalty	Total cost	Penalty	Total cost	Penalty
0.005	14.0	0.02	18.5	0.02	20.9	0.03
0.5	13.8	0.34	18.1	0.27	20.7	0.37
1	13.7	0.49	18.0	0.50	20.6	0.62
2	13.5	0.72	17.9	0.97	20.4	0.97
3	13.4	0.88	17.8	1.20	20.3	1.39
4	13.3	1.01	17.6	1.49	20.3	1.79
5	13.2	1.18	17.6	1.81	20.2	2.19

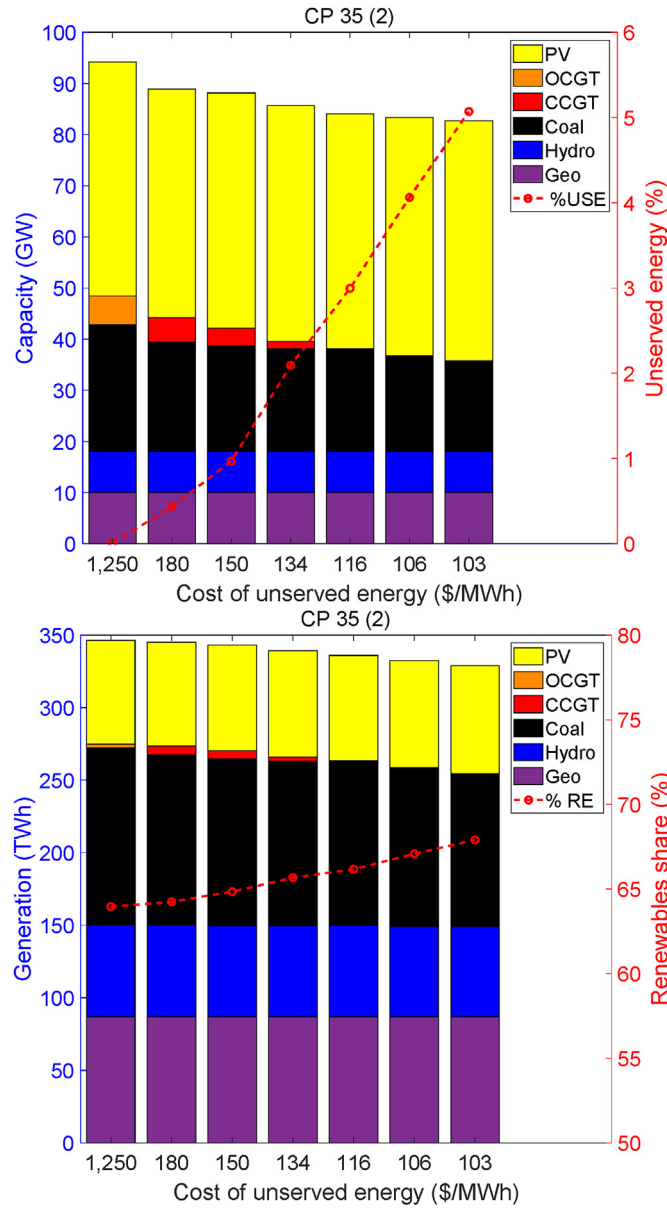


Fig. A. (Top) Least cost capacity mix and corresponding USE and (bottom) least-cost generation mix and RE shares for CP35.

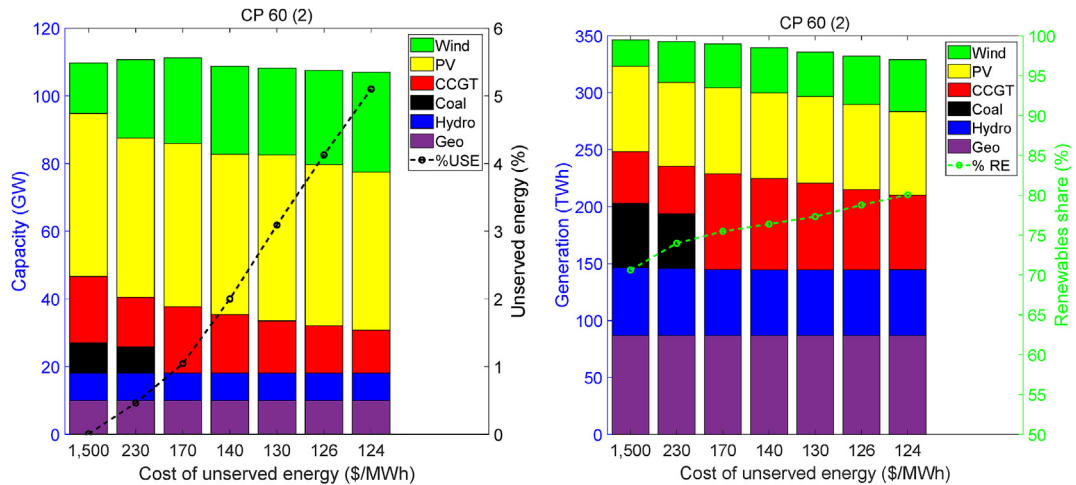


Fig. B. (Left) Least cost capacity mix and corresponding USE and (right) least-cost generation mix and RE shares for CP60.

References

- [1] IEA. Southeast Asia energy outlook 2019. Paris: International Energy Agency; 2019.
- [2] IEA. World energy outlook 2020. Paris: International Energy Agency; 2020.
- [3] Clark R, Zucker N, Urpelainen J. The future of coal-fired power generation in Southeast Asia. *Renew Sustain Energy Rev* 2020;121:109650.
- [4] Mondal MAH, Rosegrant M, Ringler C, Pradesha A, Valmonte-Santos R. The Philippines energy future and low-carbon development strategies. *Energy* 2018;147:142–54.
- [5] Das A, Halder A, Mazumder R, Saini VK, Parikh J, Parikh KS. Bangladesh power supply scenarios on renewables and electricity import. *Energy* 2018;155: 651–67.
- [6] Pupo-Roncallo O, Campillo J, Ingham D, Hughes K, Pourkashanian M. Large scale integration of renewable energy sources (RES) in the future Colombian energy system. *Energy* 2019;186:115805.
- [7] Bamisile O, Huang Q, Xu X, Hu W, Liu W, Liu Z, Chen Z. An approach for sustainable energy planning towards 100% electrification of Nigeria by 2030. *Energy* 2020;197:117172.
- [8] Dranka GG, Ferreira P. Planning for a renewable future in the Brazilian power system. *Energy* 2018;164:496–511. Part B.
- [9] Kumar S, Madlener R. CO₂ emission reduction potential assessment using renewable energy in India. *Energy* 2016;97:273–82.
- [10] Kachooee MS, Salimi M, Amidpour M. The long-term scenario and greenhouse gas effects cost-benefit analysis of Iran's electricity sector. *Energy* 2018;143: 585–96.
- [11] Mirjat NH, Uqaili MA, Harijan K, Walasai GD, Mondal MAH, Sahin H. Long-term electricity demand forecast and supply side scenarios for Pakistan (2015–2050): a LEAP model application for policy analysis. *Energy* 2018;165: 512–26. Part B.
- [12] Rady YY, Rocco MV, Serag-Eldin MA, Colombo E. Modelling for power generation sector in developing countries: case of Egypt. *Energy* 2018;165: 198–209. Part B.
- [13] Dhakouani A, et al. Long-term optimisation model of the Tunisian power system. *Energy* 2017;141:550–62.
- [14] Rego EE, Costa OLV, Ribeiro CO, Filho RIRL, Takada H, Stern J. The trade-off between demand growth and renewables: a multiperiod electricity planning model under CO₂ emissions constraints. *Energy* 2020;213:118832.
- [15] Afful-Dadzie A, Mallet A, Afful-Dadzie E. The challenge of energy transition in the Global South: the case of electricity generation planning in Ghana. *Renew Sustain Energy Rev* 2020;126:109830.
- [16] Afful-Dadzie A, Afful-Dadzie E, Abbey NA, Owusu BA, Awudu I. Renewable electricity generation target setting in developing countries: modeling, policy, and analysis. *Energy for Sustainable Development* 2020;59:83–96.
- [17] AEMO. 2019 Annual report. Melbourne: Australian Energy Market Operator Limited; 2019.
- [18] Ghorbani N, Kasaeian A, Toopshekan A, Bahrami L, Maghami A. Optimizing a hybrid wind-PV-battery system using GA-PSO and MOPSO for reducing cost and increasing reliability. *Energy* 2018;154:581–91.
- [19] Saboori H, Hemmati R, Jirdehi MA. Reliability improvement in radial electrical distribution network by optimal planning of energy storage systems. *Energy* 2015;93:2299–312.
- [20] Baghaee HR, Mirsalim M, Gharehpetian GB, Talebi HA. Reliability/cost-based multi-objective Pareto optimal design of stand-alone wind/PV/FC generation microgrid system. *Energy* 2016;115:1022–41.
- [21] Al-Shaalan AM. Essential aspects of power system planning in developing countries. *Journal of King Saud University-Engineering Sciences* 2011;23: 27–32.
- [22] Al-Shaalan AM. Reliability/cost tradeoff evaluation for interconnected electric power systems. *International Journal of Computing and Digital Systems* 2017;6(6):369–74.
- [23] Röpke L. The development of renewable energies and supply security: a trade-off analysis. *Energy Pol* 2013;61:1011–21.
- [24] Wu L, Shahidehpour M, Li T. Cost of reliability analysis based on stochastic unit commitment. *IEEE Trans Power Syst* 2008;23(3):1364–74.
- [25] Foster V, Rana A. Rethinking power sector reform in the developing world. Washington DC: The World Bank; 2020.
- [26] Gertler PJ, Lee K, Mobarak A. Electricity reliability and economic development in cities: a microeconomic perspective. UC Berkeley: Center for Effective Global Action; 2017. Available online: <https://escholarship.org/uc/item/96s8s43z>. [Accessed 3 February 2021].
- [27] P.T. PLN (Persero). PLN statistics 2018 (in Bahasa Indonesia). 2019 [Jakarta: Corporate Secretariat - P.T. PLN (Persero)].
- [28] DGE-MEMR. Electricity statistics 2018 (in Bahasa Indonesia). Jakarta: Directorate General Electricity - MEMR; 2019.
- [29] P.T. PLN (Persero). Ministry of energy and mineral resources of the Republic of Indonesia. P.T. PLN (Persero) Electricity planning 2019–2028 (in Bahasa Indonesia), Jakarta. 2019.
- [30] DEN. Outlook energy Indonesia 2019 (in Bahasa Indonesia). Jakarta: Indonesia National Energy Council; 2019.
- [31] IEEFA. Perusahaan Listrik Negara (PLN): a power company out of step with global trends. Available online: http://ieefa.org/wp-content/uploads/2018/04/PLN-A-Power-Company-out-of-Step-With-Global-Trends_April-2018.pdf. [Accessed 12 February 2020].
- [32] IESR. Indonesia's coal dynamics: toward a just energy transition. Jakarta: Institute for Essential Services Reform; 2019.
- [33] Burke PJ, Widnyana J, Anjum Z, Aisbitt E, Resosudarmo B, Baldwin KGH. Overcoming barriers to solar and wind energy adoption in two Asian giants: India and Indonesia. *Energy Pol* 2019;132:1216–28.
- [34] IISD. Indonesia's coal price cap: a barrier to renewable energy deployment. Winnipeg: The International Institute for Sustainable Development; 2019.
- [35] CEEM. National electricity market optimiser (NEMO). Available online: <http://ceem.unsw.edu.au/open-source-tools>. [Accessed 20 February 2018].
- [36] Tanoto Y, Haghdadi N, Bruce A, MacGill I. Clustering based assessment of cost, security and environmental tradeoffs with possible future electricity generation portfolios. *Appl Energy* 2020;270:115219.
- [37] Elliston B, MacGill I, Diesendorf M. Least cost 100% renewable electricity scenarios in the Australian National Electricity Market. *Energy Pol* 2013;59: 270–82.
- [38] Elliston B, MacGill I, Diesendorf M. Comparing least cost scenarios for 100% renewable electricity with low emission fuel scenarios in the Australian National Electricity Market. *Renew Energy* 2014;66:196–204.
- [39] Elliston B, Riesz J, MacGill I. What cost for more renewables? The incremental cost of renewable generation - an Australian National Electricity Market case study. *Renew Energy* 2016;95:127–39.
- [40] Simaremare AA, Bruce A, MacGill I. Least cost high renewable energy penetration scenarios in the Java Bali grid system. In: *Proceeding of Asia-Pacific solar Research Conference*; 2017. 2017, Melbourne, Australia.
- [41] Tanoto Y, MacGill I, Bruce A, Haghdadi N. Photovoltaic deployment experience and technical potential in Indonesia's Java-Madura-Bali electricity grid. In: *Proceeding of Asia-Pacific solar Research Conference*; 2017. 2017, Melbourne, Australia.
- [42] Tanoto Y, Bruce A, MacGill I, Haghdadi N. Impact of high variable renewable penetrations on dynamic operating reserves in future Indonesian electricity industry scenarios. In: *Proceeding of IEEE international Conference on environment and electrical Engineering and 2019 IEEE industrial and commercial power system Europe*; 2019. 2019, Genoa, Italy.
- [43] IRENA. Renewable energy prospects: Indonesia, a REmap analysis. Abu Dhabi: International Renewable Energy Agency; 2017.
- [44] P.T. PLN (Persero). Annual demand data 2015 of Java-Bali interconnection (in Bahasa Indonesia). Jakarta: PLN Java-Bali Load Dispatch Centre; 2017.
- [45] Pfenninger S, Staffell I. Long-term patterns of European PV output using 30 years of validated hourly reanalysis and satellite data. *Energy* 2016;114: 1251–65.
- [46] EMD International A/S. Wind energy resources in Indonesia. Accessed on 20 March 2018. Available online: <http://indonesia.windprospecting.com/>; 2017.
- [47] DG NREEC. Statistics book of new, renewable energy and energy conservation 2016 (in Bahasa Indonesia). Jakarta: Directorate general of new, renewable energy and energy conservation of the Republic of Indonesia. 2016.
- [48] Veldhuis AJ, Reinders AH. Reviewing the potential and cost-effectiveness of grid-connected solar PV in Indonesia on a provincial level. *Renew Sustain Energy Rev* 2013;27:315–24.
- [49] DEN. Technology data for the Indonesian power sector: catalogue for generation and storage of electricity. Jakarta: Indonesia National Energy Council; 2017.
- [50] DEN. Indonesia energy outlook 2016. Jakarta: Indonesia National Energy Council; 2016.
- [51] IEA. Southeast Asia energy outlook 2015. Paris: International Energy Agency; 2015.
- [52] IEA. World energy outlook 2015. Paris: International Energy Agency; 2015.
- [53] LAZARD. Lazard's levelized cost of energy analysis – version 11.0. 2017. Available online: <https://www.lazard.com/media/450337/lazard-levelized-cost-of-energy-version-11.0.pdf>. [Accessed 15 February 2018].
- [54] NREL. 2017. NREL annual technology baseline (ATB). Accessed on 15 February 2018. Available online: <https://atb.nrel.gov/>.
- [55] REN21. Renewables 2016 global status report. Paris: Renewable Energy Policy Network for the 21st Century; 2016.